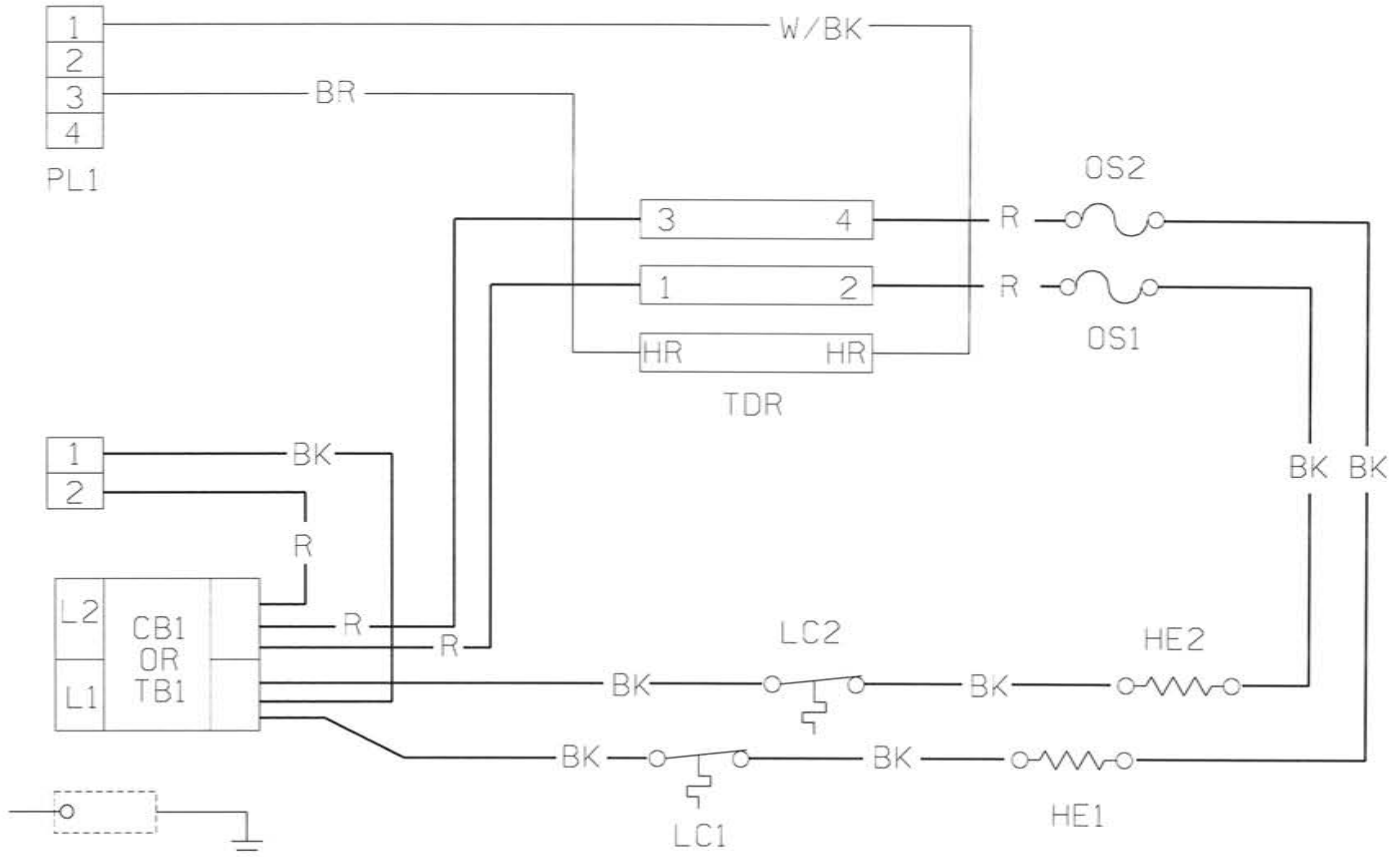


COMPONENT CODE

PL	PLUG
HE	HEATING ELEMENT
LC	LIMIT CONTROL
CB	CIRCUIT BREAKER
TDR	TIME DELAY RELAY
HC	HEATER CONTROLLER
TB	TERMINAL BLOCK
OS	"ONE-SHOT" SINGLE OPERATION TEMP SWITCH
HR	HEATER RELAY

NOTES:

WIRING INFORMATION

LINE VOLTAGE
- -FACTORY STANDARD ——————
- -FACTORY OPTION -·-·-·-·-·-
- -FIELD INSTALLED - - - - - -

LOW VOLTAGE
- -FACTORY STANDARD ——————
- -FACTORY OPTION -·-·-·-·-·-
- -FIELD INSTALLED - - - - - -

REPLACEMENT WIRE
- -MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105 C° MIN.)

WARNING
- -CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C. AND LOCAL CODES AS APPLICABLE.

WIRE COLOR CODE

BK__BLACK	O___ORANGE	W/BK___WHITE
BR__BROWN	PR__PURPLE	WITH BLACK STRIPE
BL__BLUE	R___RED	
G___GREEN	W___WHITE	
GY__GRAY	Y___YELLOW	

ELECTRICAL WIRING DIAGRAM
HEATER KIT
240 V 1 PH.
8, 10 KW - SINGLE STAGE

DR. BY	APP. BY	DATE	DWG. NO.	REV
JHB	SC	9/10/09	90-103367-02	01