

WIRING DIAGRAM

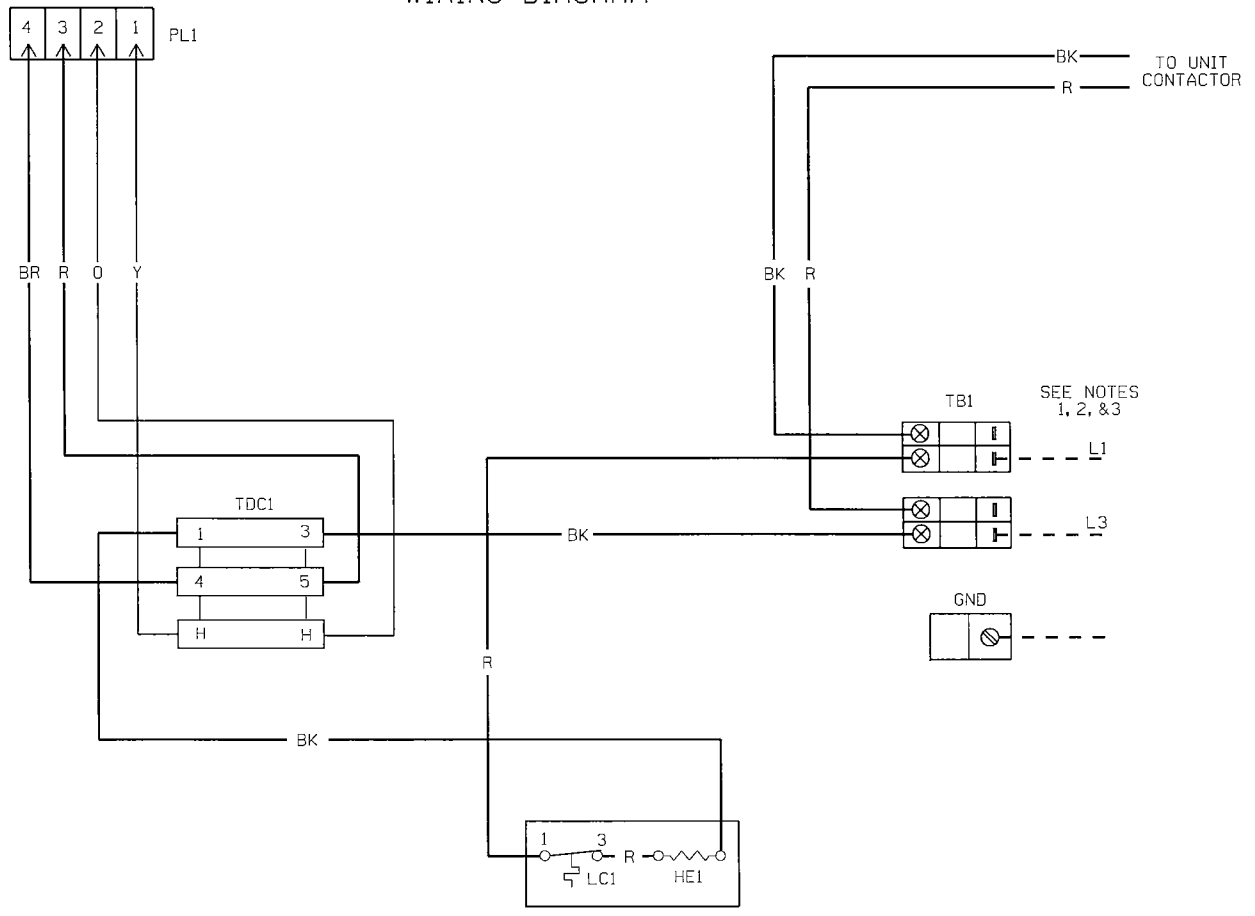

SCHEMATIC DIAGRAM

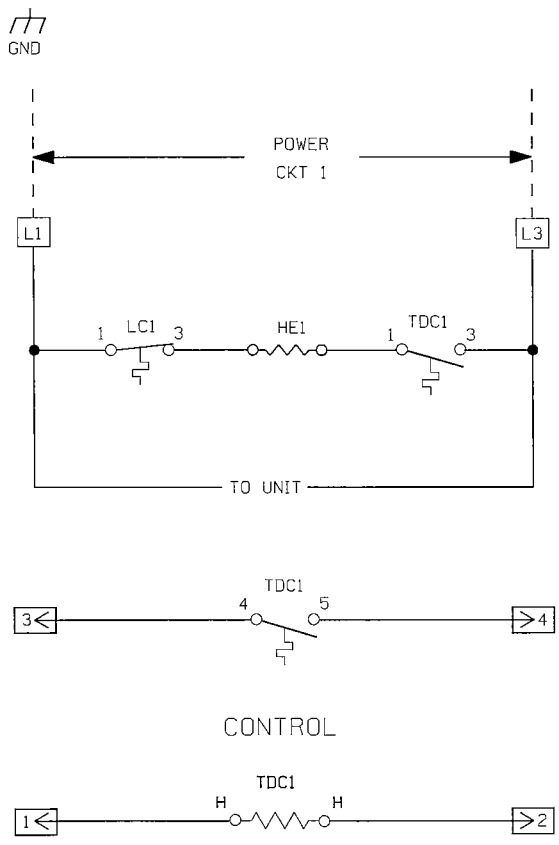

COMPONENT CODE

GND	GROUND
HE	HEATER ELEMENT
LC	LIMIT CONTROL
PL	PLUG
TB	TERMINAL BLOCK
TDC	TIME DELAY CONTROL

NOTES:

1. USE COPPER WIRE ONLY
2. CONNECT FIELD WIRING IN GROUNDED RAINTIGHT CONDUIT TO 60 HZ, SINGLE PHASE POWER
3. SEE INSTALLATION INSTRUCTIONS FOR FIELD WIRE SIZING

WIRING INFORMATION

LINE VOLTAGE
- -FACTORY STANDARD ——————
- -FACTORY OPTION — - — - —
- -FIELD INSTALLED - - - - - - -

LOW VOLTAGE
- -FACTORY STANDARD ——————
- -FACTORY OPTION — - — - —
- -FIELD INSTALLED - - - - - - -

REPLACEMENT WIRE
- -MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105 C°MIN.)

WARNING
- -CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C. AND LOCAL CODES AS APPLICABLE.

WIRE COLOR CODE

BK	BLACK	O	ORANGE
BR	BROWN	PR	PURPLE
BL	BLUE	R	RED
G	GREEN	W	WHITE
GY	GRAY	Y	YELLOW

ELECTRICAL WIRING DIAGRAM

2.8, AND 4.8 KW
208/240 VOLT, 60 HZ. SINGLE PHASE

DR. BY	APP. BY	DATE	DWG. NO.	REV
TWC	MDK	12-19-96	90-23533-01	01

DWG. NO. 90-23533-01 REV 01