
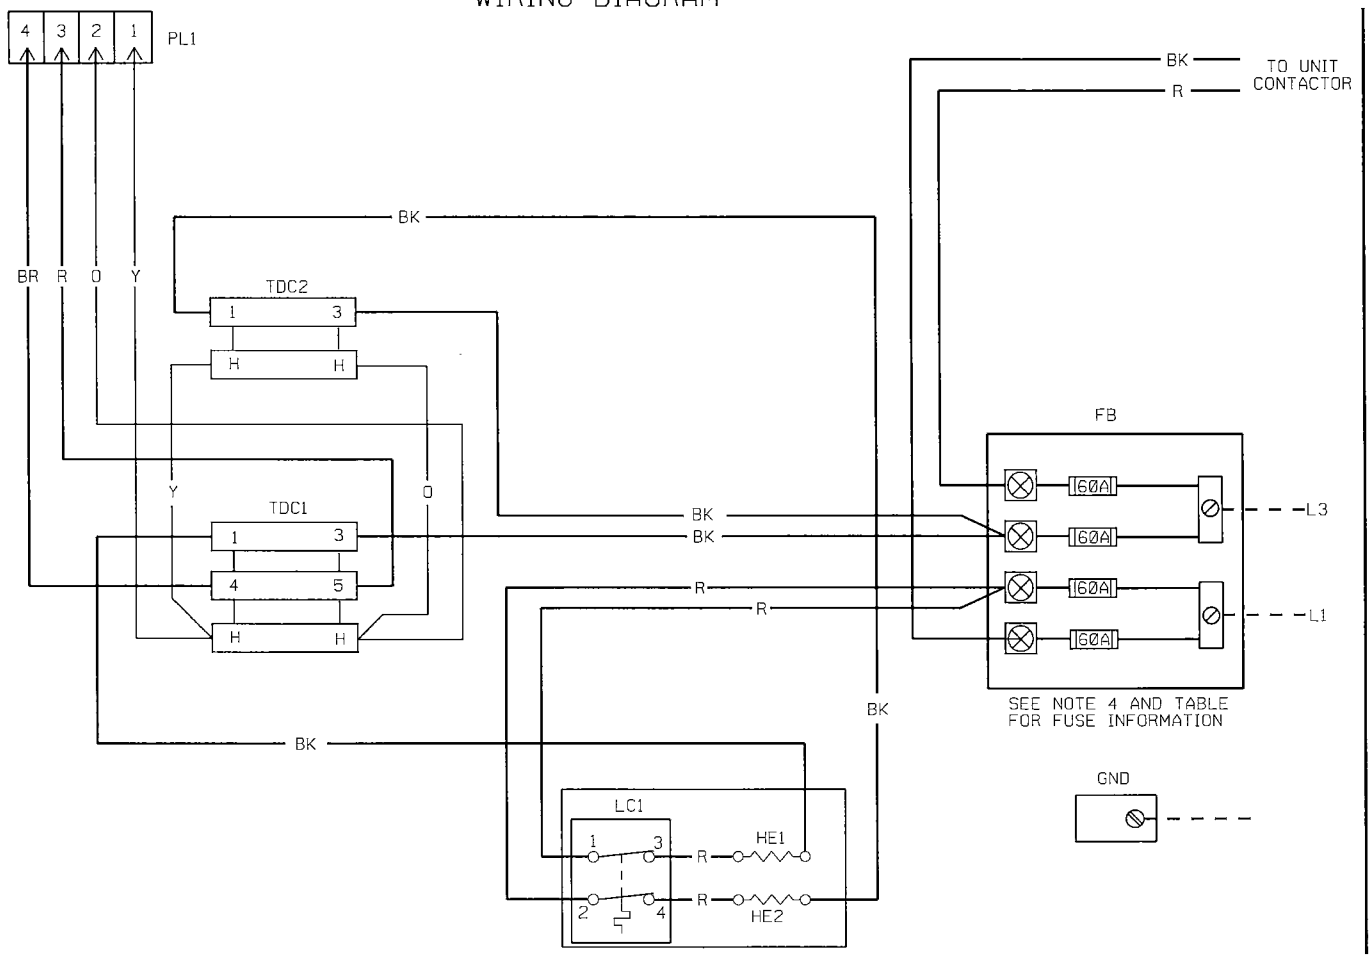


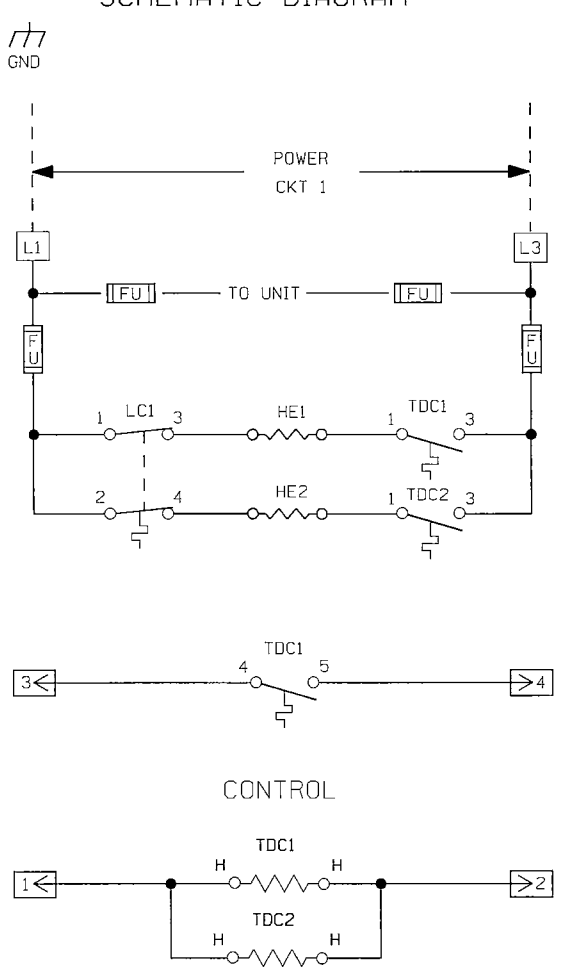

COMPONENT CODE

FB	FUSE BLOCK
FU	FUSE
GND	GROUND
HE	HEATER ELEMENT
LC	LIMIT CONTROL
PL	PLUG
TB	TERMINAL BLOCK
TDC	TIME DELAY CONTROL

NOTES:

1. USE COPPER WIRE ONLY
2. CONNECT FIELD WIRING IN GROUNDED RAINTIGHT CONDUIT TO 60 HZ, SINGLE PHASE POWER
3. SEE INSTALLATION INSTRUCTIONS FOR FIELD WIRE SIZING
4. REPLACEMENT FUSES SHOULD BE NONRENEWABLE CARTRIDGE TYPE, EQUIVALENT TO ORIGINAL

KW RATING	FACTORY INSTALLED FUSES		
	HEATER SUPPLY		UNIT SUPPLY
	US-TYPE K5	CAN-TYPE P	TIME DELAY
5.6 & 9.6	2 @ 60	2 @ 60	2 @ 60

WIRING INFORMATION

LINE VOLTAGE
- -FACTORY STANDARD
- -FACTORY OPTION
- -FIELD INSTALLED

LOW VOLTAGE
- -FACTORY STANDARD
- -FACTORY OPTION
- -FIELD INSTALLED

REPLACEMENT WIRE
- -MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105 C° MIN.)

WARNING
- -CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C. AND LOCAL CODES AS APPLICABLE.

WIRE COLOR CODE

BK	BLACK	O	ORANGE
BR	BROWN	PR	PURPLE
BL	BLUE	R	RED
G	GREEN	W	WHITE
GY	GRAY	Y	YELLOW

ELECTRICAL WIRING DIAGRAM

5.6 & 9.6 KW (60A UNIT FUSES)
208/240 VOLT, 60 HZ. SINGLE PHASE
TUTCO PART NO.: 46-5148-00

DR. BY	APP. BY	DATE	DWG. NO.	REV
TWC		12-27-96	90-23533-03	01

DWG. NO. 90-23533-03 REV 01