


INSTRUCTIONS | LETTERING

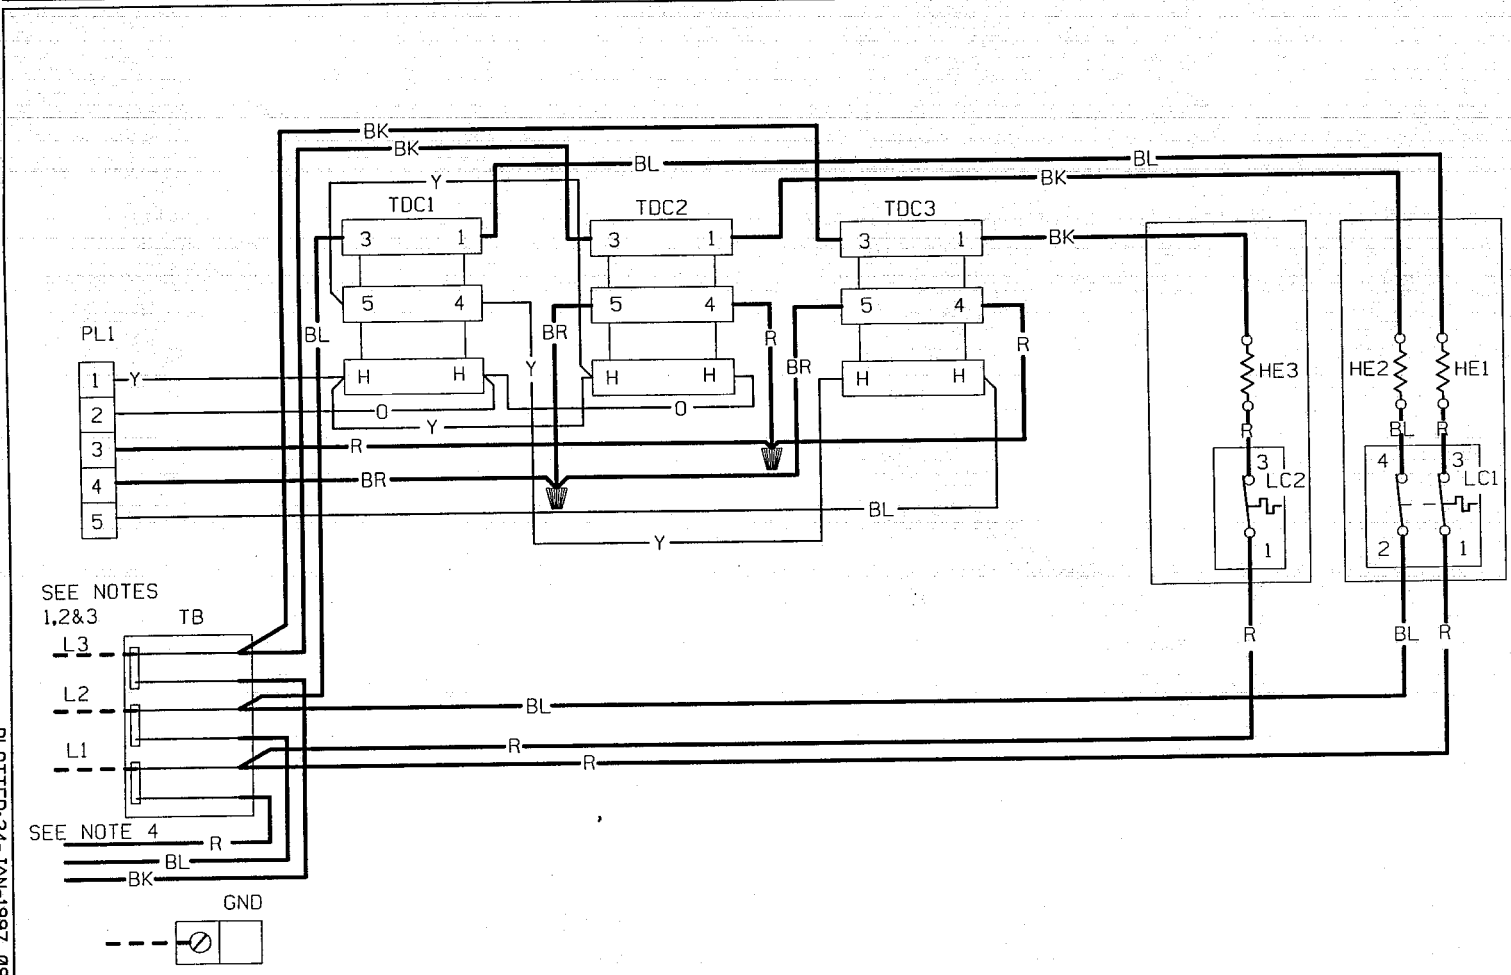

SCHEMATIC DIAGRAM

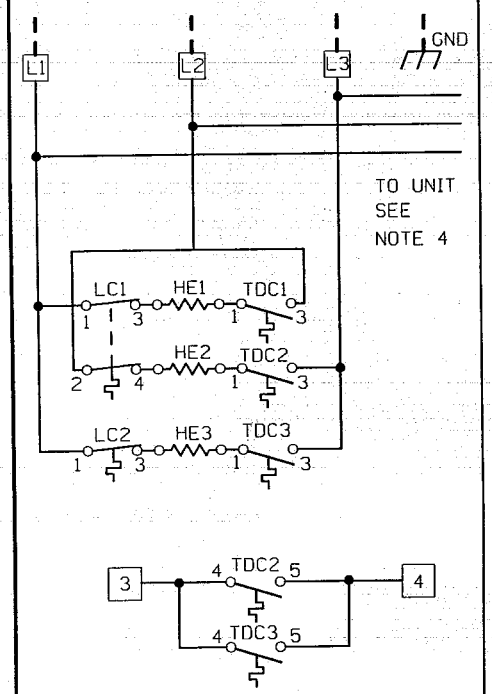

CONTROL

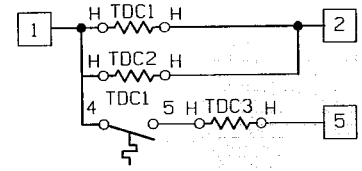

COMPONENT CODE

GND	GROUND
HE	HEATER ELEMENT
LC	LIMIT CONTROL
PL	PLUG
TB	TERMINAL BLOCK
TDC	TIME DELAY CONTROL
	WIRE NUT

NOTES:

1. USE COPPER WIRE ONLY.
2. CONNECT FIELD WIRING IN GROUNDED RAINTIGHT CONDUIT TO 60HZ THREE PHASE POWER.
3. SEE INSTALLATION INSTRUCTIONS FOR FIELD SIZING.
4. WIRE FACTORY CONNECTED FROM CONTACTOR IN UNIT CONTROL BOX.

WIRING INFORMATION

LINE VOLTAGE
- -FACTORY STANDARD
- -FACTORY OPTION
- -FIELD INSTALLED

LOW VOLTAGE
- -FACTORY STANDARD
- -FACTORY OPTION
- -FIELD INSTALLED

REPLACEMENT WIRE
- -MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105° C MIN.)

WARNING
- -CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO N.E.C., (C.E.C.-CANADA) AND LOCAL CODES.

WIRE COLOR CODE

BK	BLACK	O	ORANGE
BR	BROWN	PR	PURPLE
BL	BLUE	R	RED
G	GREEN	W	WHITE
GY	GRAY	Y	YELLOW

ELECTRICAL WIRING DIAGRAM

9.6 KW
208/240 VOLT, 60 HZ.
THREE PHASE
TUTCO PART NO.: 46-5198-00

DR. BY	APP. BY	DATE	DWG. NO.	REV
TWC		12-19-96	90-23533-07	00

DWG. NO. 90-23533-07 REV 00

PLOTTED:24-JAN-1997 09:55