
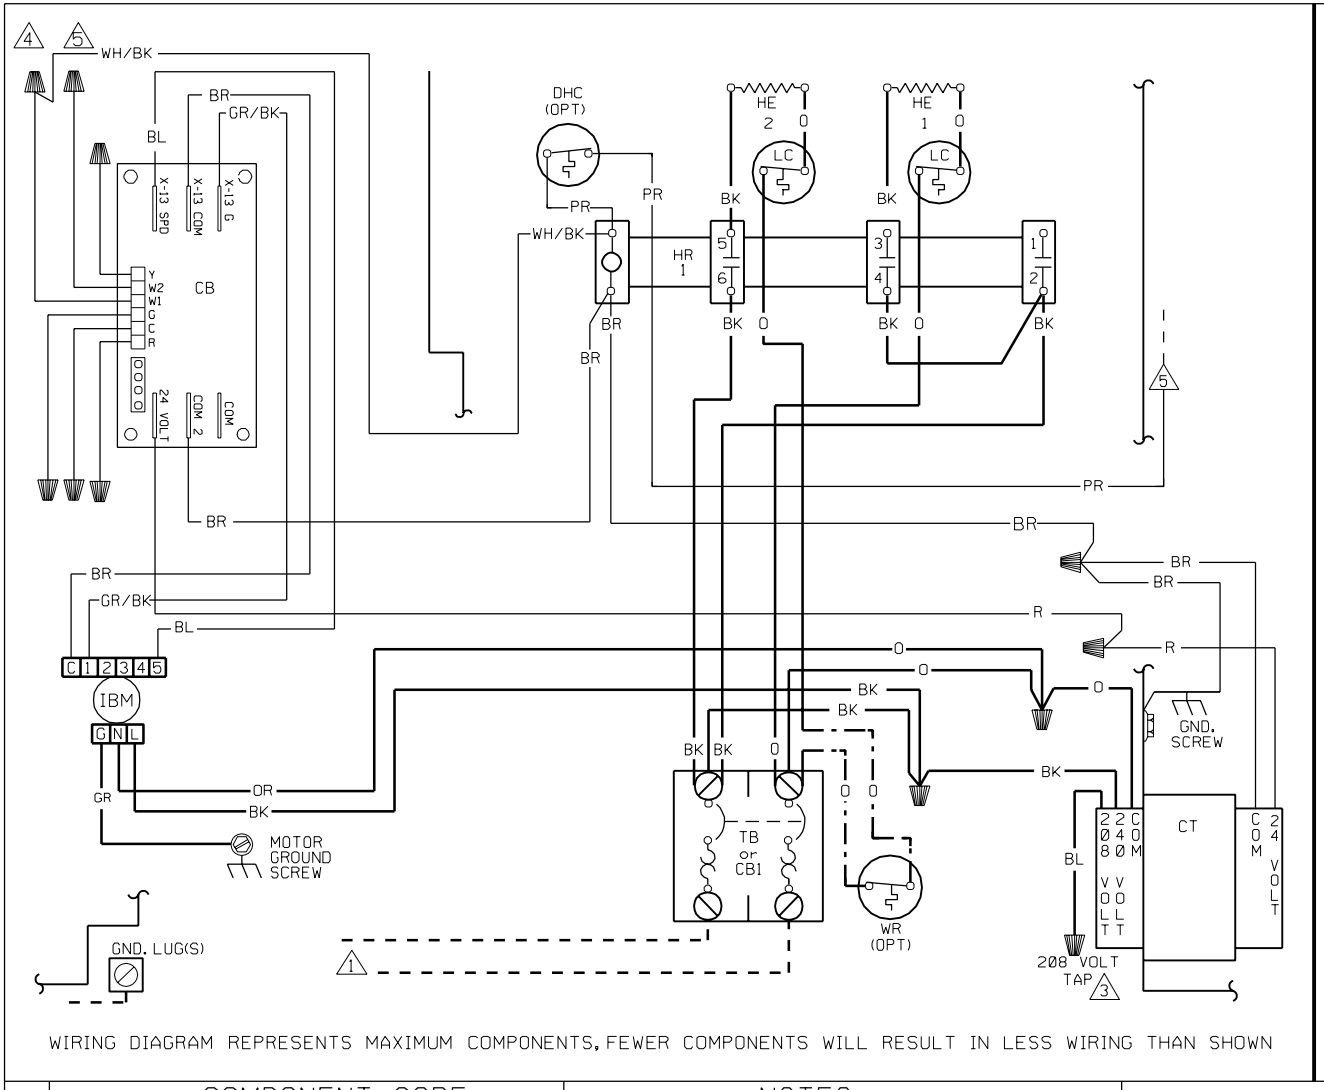


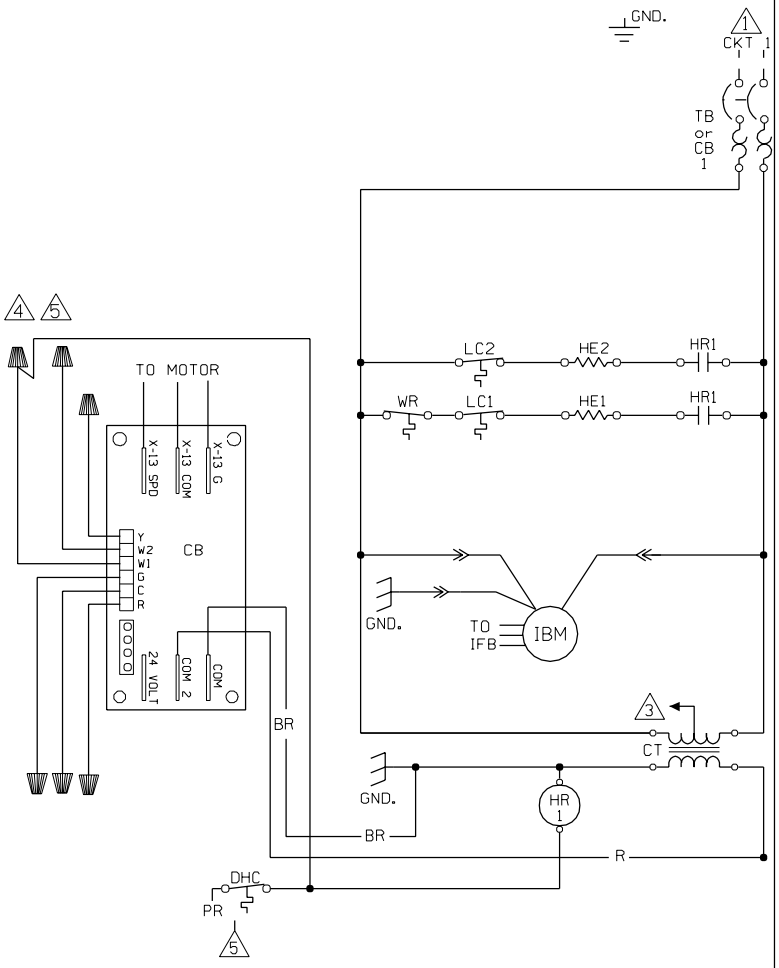

COMPONENT CODE

C	MOTOR CONTROL PLUG
CB	CIRCUIT BREAKER
CT	CONTROL TRANSFORMER
DHC	DEFROST HEATER CONTROL
GND	GROUND
HE	HEATER ELEMENT
HR	HEATER RELAY
IBM	INDOOR BLOWER MOTOR
LC	LIMIT CONTROL
P	MOTOR POWER PLUG
TB	TERMINAL BLOCK (HI VOLT)
WR	WATT RESTRICTOR
▲	WIRE NUT

NOTES:

1. CONNECT SUPPLY WIRING FOR VOLTAGE, PHASE AND HERTZ SHOWN ON RATING PLATE.
2. SUPPLY WIRE MUST BE RATED AT 75° C MIN. SEE INSTRUCTIONS FOR SIZE.
3. CT FACTORY WIRED FOR 240 VOLTS. USE O & BL FOR 208 VOLTS.
4. CONTROL WIRING TO THERMOSTAT SUB-BASE.
5. CONTROL WIRING TO OUTDOOR UNIT.
6. FOR USE WITH COPPER CONDUCTORS ONLY.

WIRING INFORMATION

LINE VOLTAGE
- -FACTORY STANDARD
- -FACTORY OPTION
- -FIELD INSTALLED

LOW VOLTAGE
- -FACTORY STANDARD
- -FACTORY OPTION
- -FIELD INSTALLED

REPLACEMENT WIRE
- -MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105 C° MIN.)

WARNING
- -CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C. AND LOCAL CODES AS APPLICABLE.

WIRE COLOR CODE

BK	BLACK	GY	GRAY	R	RED
BR	BROWN	O	ORANGE	W	WHITE
BL	BLUE	PK	PINK	Y	YELLOW
G	GREEN	PR	PURPLE		

ELECTRICAL WIRING DIAGRAM

J07S

DR. BY	APP. BY	DATE	DWG. NO.	REV
MGR		2-21-06	90-102268-03	02

DWG. NO. 90-102268-03 REV 02