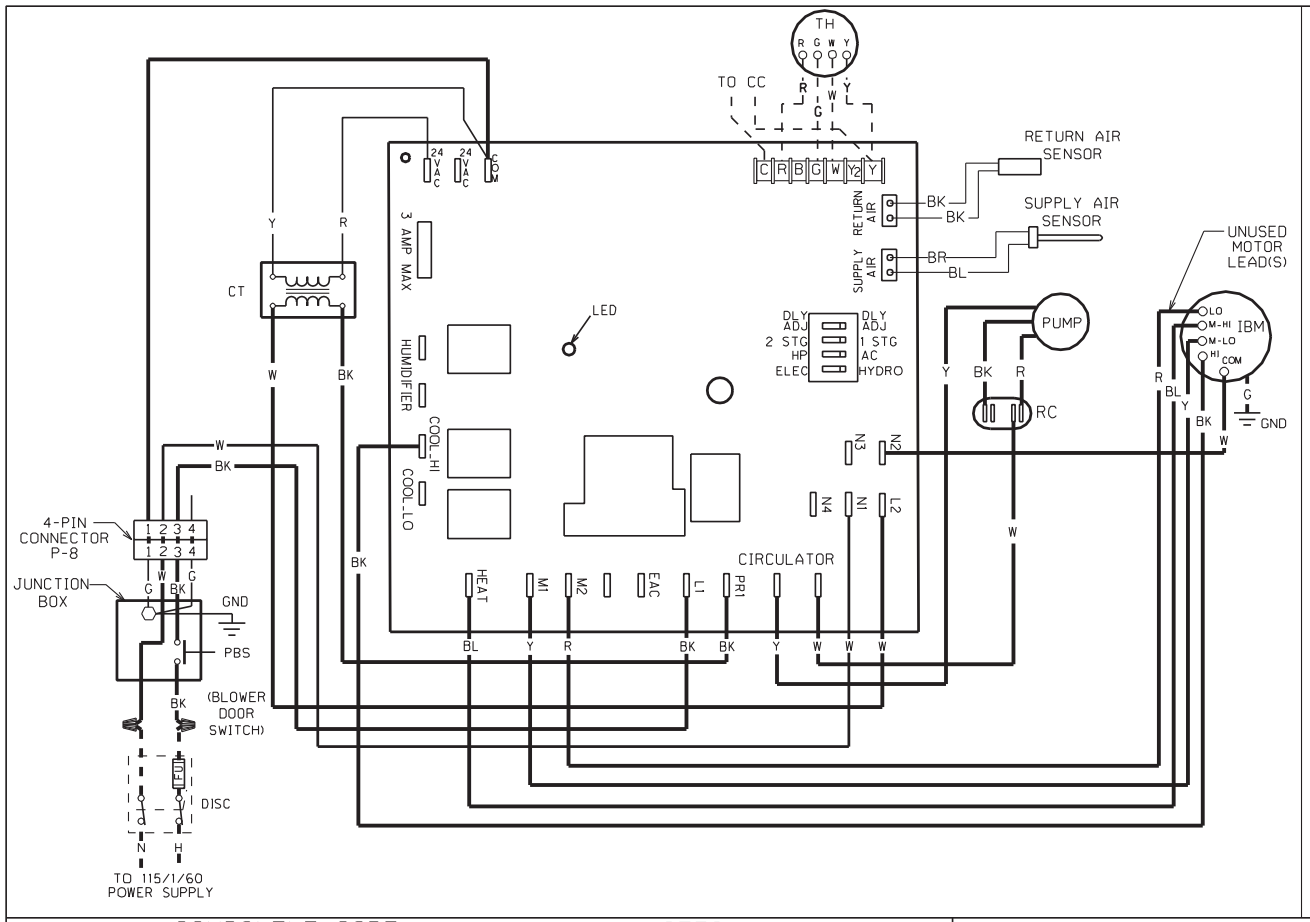
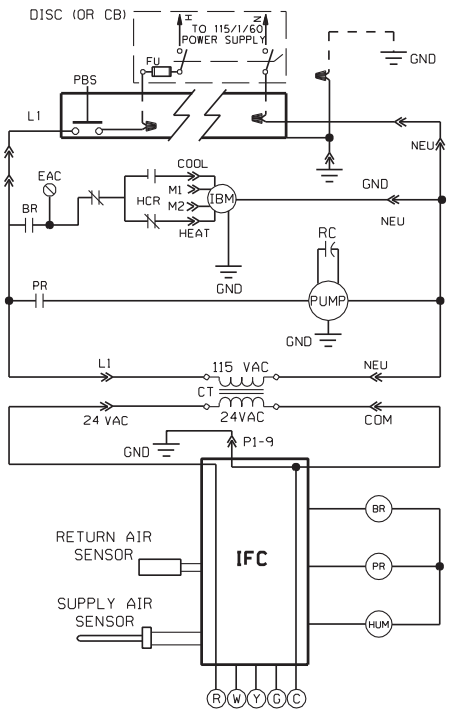



## COMPONENT CODE

| | |
|---|---|
| BR | BLOWER RELAY |
| CC | COMPRESSOR CONTACTOR |
| CT | CONTROL TRANSFORMER |
| DISC | DISCONNECT SWITCH |
| EAC | ELECTRIC AIR CLEANER |
| FR | FAN RELAY |
| FS | FLOW SWITCH |
| FU | FUSE |
| GND | GROUND |
| HUM | HUMIDIFIER RELAY |
| IBM | INDOOR BLOWER MOTOR |
| PBS | PUSH BUTTON SWITCH |
| PL | PLUG |
| PR | PUMP RELAY |
| TH | THERMOSTAT (H/C) |
| ▲ | WIRE NUT |

## NOTES:

1. REFER TO SPEC. SHEET FOR ACTUAL FACTORY MOTOR TAP PLACEMENT OF "HEAT" & "LOW", AS SOME MODELS MAY BE DIFFERENT THAN SHOWN HERE. ALSO, REFER TO SPEC. SHEET OR INSTALLATION MANUAL IF WIRING OF HEAT AND/OR COOL SPEEDS IS NOT DESIREABLE.

2. CONNECT UNUSED MOTOR LEADS TO M1 AND/OR M2.

## WIRING INFORMATION

LINE VOLTAGE
- -FACTORY STANDARD
- -FACTORY OPTION
- -FIELD INSTALLED

LOW VOLTAGE
- -FACTORY STANDARD
- -FACTORY OPTION
- -FIELD INSTALLED

REPLACEMENT WIRE
- -MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105 C.MIN.)

WARNING
- -CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C., NATIONAL WIRING REGULATIONS, AND LOCAL CODES AS APPLICABLE.

## WIRE COLOR CODE

| | |
|---|---|
| BK__BLACK | O___ORANGE |
| BR__BROWN | PR__PURPLE |
| BL__BLUE | R___RED |
| G___GREEN | W___WHITE |
| GY__GRAY | Y___YELLOW |

# ELECTRICAL WIRING DIAGRAM

## HYDRONIC AIR HANDLER
## EcoTech MOTOR

| DR. BY | APP. BY | DATE | DWG. NO. | REV |
|---|---|---|---|---|
| MGR | | 7-24-13 | 90-103346-04 | 00 |