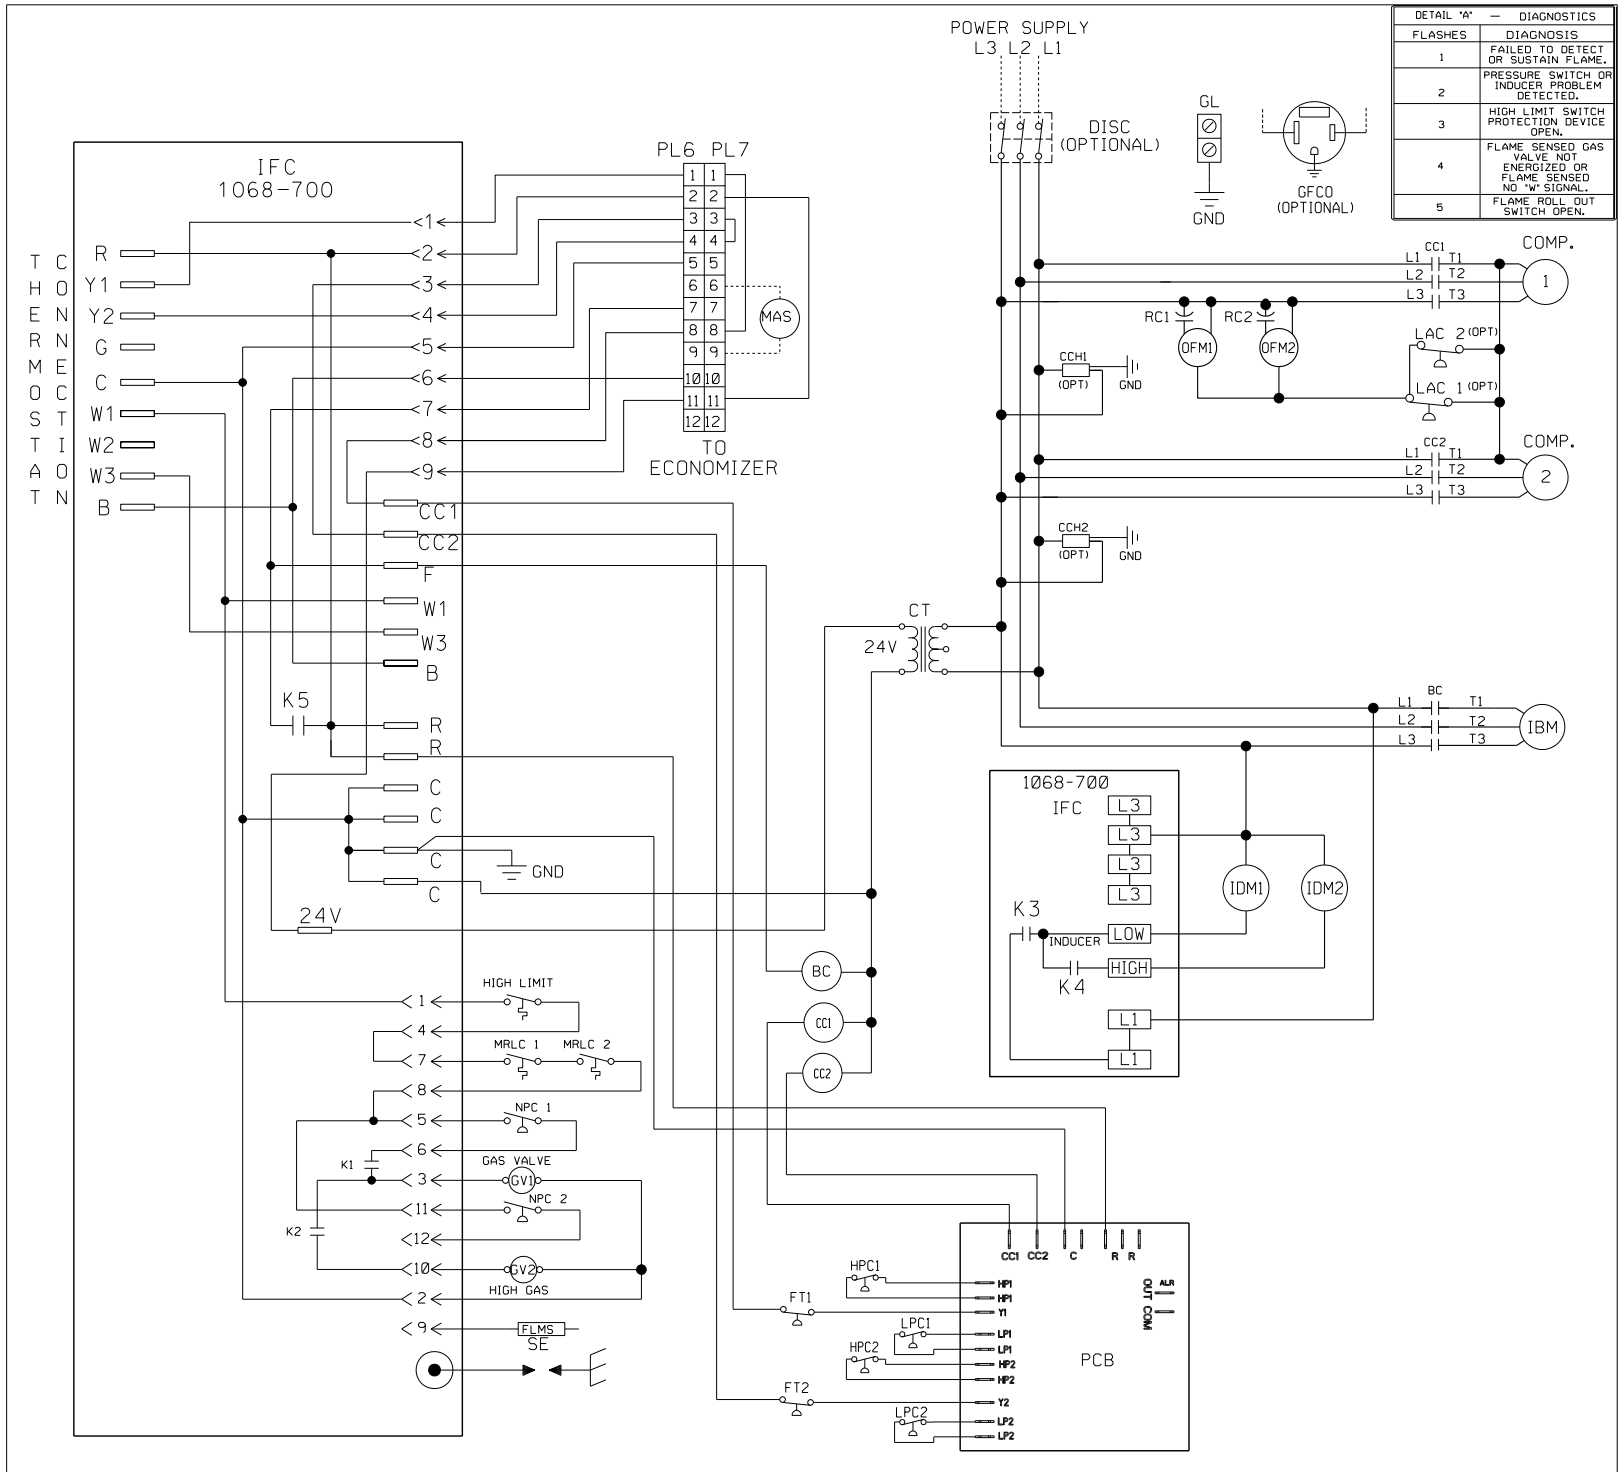


COMPONENT CODE

BC	BLOWER CONTACTOR	IDM	INDUCED DRAFT MOTOR
CC	COMPRESSOR CONTACTOR	IFC	INTEGRATED FURNACE CONTROL
CCH	CRANKCASE HEATER	LC	LIMIT CONTROL
COMP	COMPRESSOR	LPC	LOW PRESSURE CONTROL
CT	CONTROL TRANSFORMER	MAS	MIX AIR SENSOR
DISC	DISCONNECT SWITCH	MRLC	MANUAL RESET LIMIT CONTROL
FLMS	FLAME SENSOR	NPC	NEGATIVE PRESSURE CONTROL
FT	FREEZE STAT	OFM	OUTDOOR FAN MOTOR
GFCO	GROUND FAULT CONVENIENCE OUTLET	PCB	PRESSURE CONTROL BOARD
GL	GROUND LUG	PL	PLUG
GND	GROUND	PT	POWER TRANSFORMER
GV	GAS VALVE	RC	RUN CAPACITOR
HPC	HIGH PRESSURE CONTROL	SE	SPARK ELECTRODE
IBM	INDOOR BLOWER MOTOR BELT DRIVE	TB	TERMINAL BLOCK

WIRING INFORMATION

LINE VOLTAGE
- -FACTORY STANDARD ———
- -FACTORY OPTION -·-·-·-
- -FIELD INSTALLED - - - -

LOW VOLTAGE
- -FACTORY STANDARD ———
- -FACTORY OPTION -·-·-·-
- -FIELD INSTALLED - - - -

REPLACEMENT WIRE
- -MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105° C MIN.)

WARNING
- -CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C., NATIONAL WIRING REGULATIONS, AND LOCAL CODES AS APPLICABLE.

WIRE COLOR CODE

BK	BLACK	O	ORANGE
BR	BROWN	PR	PURPLE
BL	BLUE	R	RED
G	GREEN	W	WHITE
GY	GRAY	Y	YELLOW

WIRING SCHEMATIC

(-)KKL/KNL-B151

208-230/460V, 3 PH, 60 HZ.

200-220/380-415V, 3 PH, 50 HZ

DR. BY	APP. BY	DATE	DWG. NO.	REV
MGR		8-14-12	90-102891-07	01