
WIRING DIAGRAM

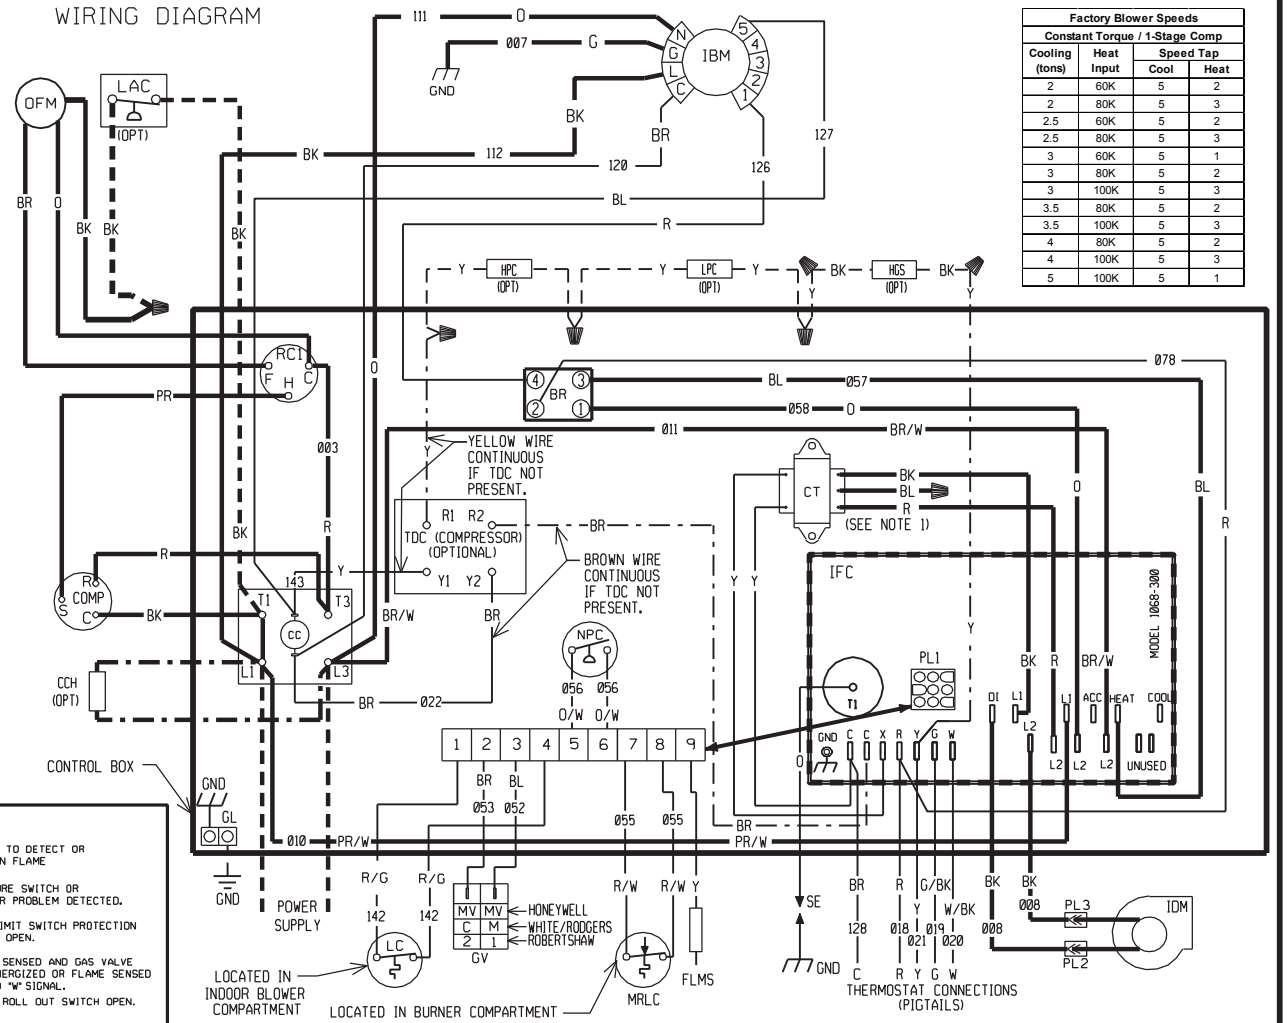

Factory Blower Speeds			
Constant Torque / 1-Stage Comp			
Cooling (tons)	Heat Input	Speed Tap	
		Cool	Heat
2	60K	5	2
2	80K	5	3
2.5	60K	5	2
2.5	80K	5	3
3	60K	5	1
3	80K	5	2
3	100K	5	3
3.5	80K	5	2
3.5	100K	5	3
4	80K	5	2
4	100K	5	3
5	100K	5	1

DIAGNOSTICS

1 FLASH - FAILED TO DETECT OR SUSTAIN FLAME


2 FLASH - PRESSURE SWITCH OR INDUCER PROBLEM DETECTED.

3 FLASH - HIGH LIMIT SWITCH PROTECTION DEVICE OPEN.

4 FLASH - FLAME SENSED AND GAS VALVE NOT ENERGIZED OR FLAME SENSED AND NO "W" SIGNAL.

5 FLASH - FLAME ROLL OUT SWITCH OPEN.

WIRING SCHEMATIC

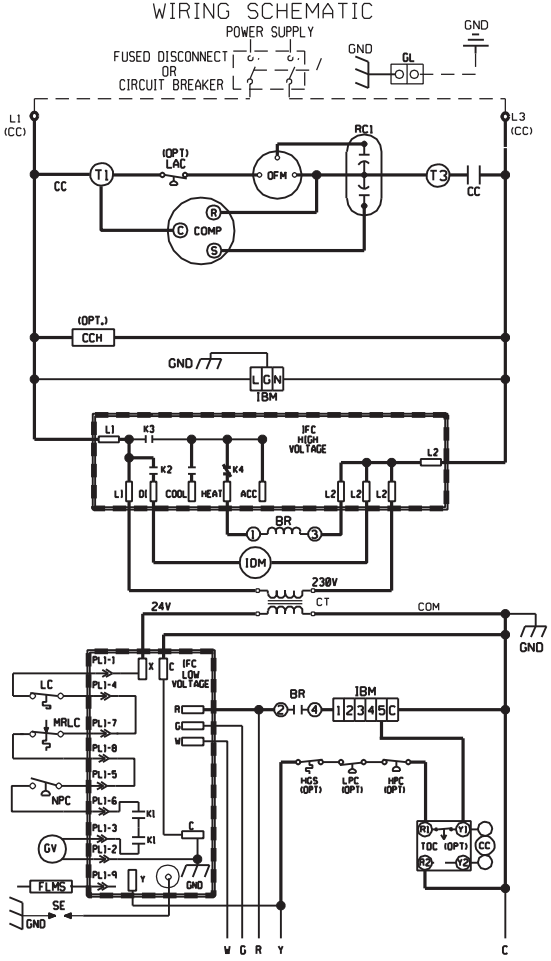

WIRE COLOR CODE

BK.....BLACK	G.....GREEN	PR.....PURPLE
BR.....BROWN	GY.....GRAY	R.....RED
BL.....BLUE	O.....ORANGE	W.....WHITE
		Y.....YELLOW

WIRING INFORMATION

LINE VOLTAGE
-FACTORY STANDARD ——————
-FACTORY OPTION —·—·—·—·—
-FIELD INSTALLED - - - - - -

LOW VOLTAGE
-FACTORY STANDARD —·—·—·—·—
-FIELD INSTALLED - - - - - - -

REPLACEMENT WIRE
-MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105C. MIN.)

WARNING
-CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C., NATIONAL WIRING REGULATIONS, AND LOCAL CODES AS APPLICABLE.

NOTES

1. MAIN UNIT TRANSFORMER PRIMARY LEADS: 60 HZ. RED-COMMON BLUE-208 V BLACK-230 V INTERCHANGE BLACK & BLUE LEADS FOR 208 V TRANSFORMER OPERATION.
2. MOTORS & COMPRESS R THERMALLY PROTECTED.
3. CONNECTORS SUITABLE FOR USE WITH COPPER CONDUCTORS ONLY.
4. CONNECT FIELD WIRING IN GROUNDED RAINTIGHT CONDUIT TO 60 HZ FUSED DISCONNECT.
5. LOW VOLTAGE CIRCUIT IS N.E.C. CLASS 2 WITH A CLASS 2 TRANSFORMER 24 VOLT, 50/60 HERTZ SUPPLIED.
6. REPLACEMENT FUSES MUST BE SAME TYPE & SIZE AS ORIGINAL.
7. HPC IS STANDARD ON UNITS WITH MICRO CHANNEL COILS AND REPLACES WIRE 143.

COMPONENT CODES

BR	BLOWER RELAY	LC	LIMIT CONTROL
CC	COMPRESSOR CONTACTOR	LPC	LOW PRESSURE CONTROL
CCH	CRANKCASE HEATER	MRLC	MAN. RESET LIMIT CONTROL
COMP	COMPRESSOR	NPC	NEG. PRESSURE CONTROL
CT	CONTROL TRANSFORMER	OFM	OUTDOOR FAN MOTOR
FLMS	FLAME SENSOR	OPT	OPTIONAL
GL	GROUND LUG	PL	PLUG
GND	GROUND	RC	RUN CAPACITOR
GV	GAS VALVE		
HPC	HIGH PRESSURE CONTROL	SE	SPARK ELECTRODE
IBM	INDOOR BLOWER MOTOR	TDC	TIME DELAY CONTROL
IDM	INDUCED DRAFT MOTOR		WIRE NUT
IFC	ITEGRATED FURNACE CONTROL		
HGS	HOT GAS SENSOR		
LAC	LOW AMBIENT COOLING CONTROL		

ELECTRICAL WIRING DIAGRAM

2.0 - 5.0 TON SINGLE STAGE GAS/ELECTRIC
W/ INTEGRATED FURNACE CONTROL
W/ CONSTANT TORQUE BLOWER MOTOR
208/230V, 1-PHASE

APPROVED:		CHECKED:	ORIGINAL RELEASE NO.:
MODELED BY:	ZJW	DATE: 05-07-14	R-1059S015
PART NO.:	90-23626-24		REV: 01