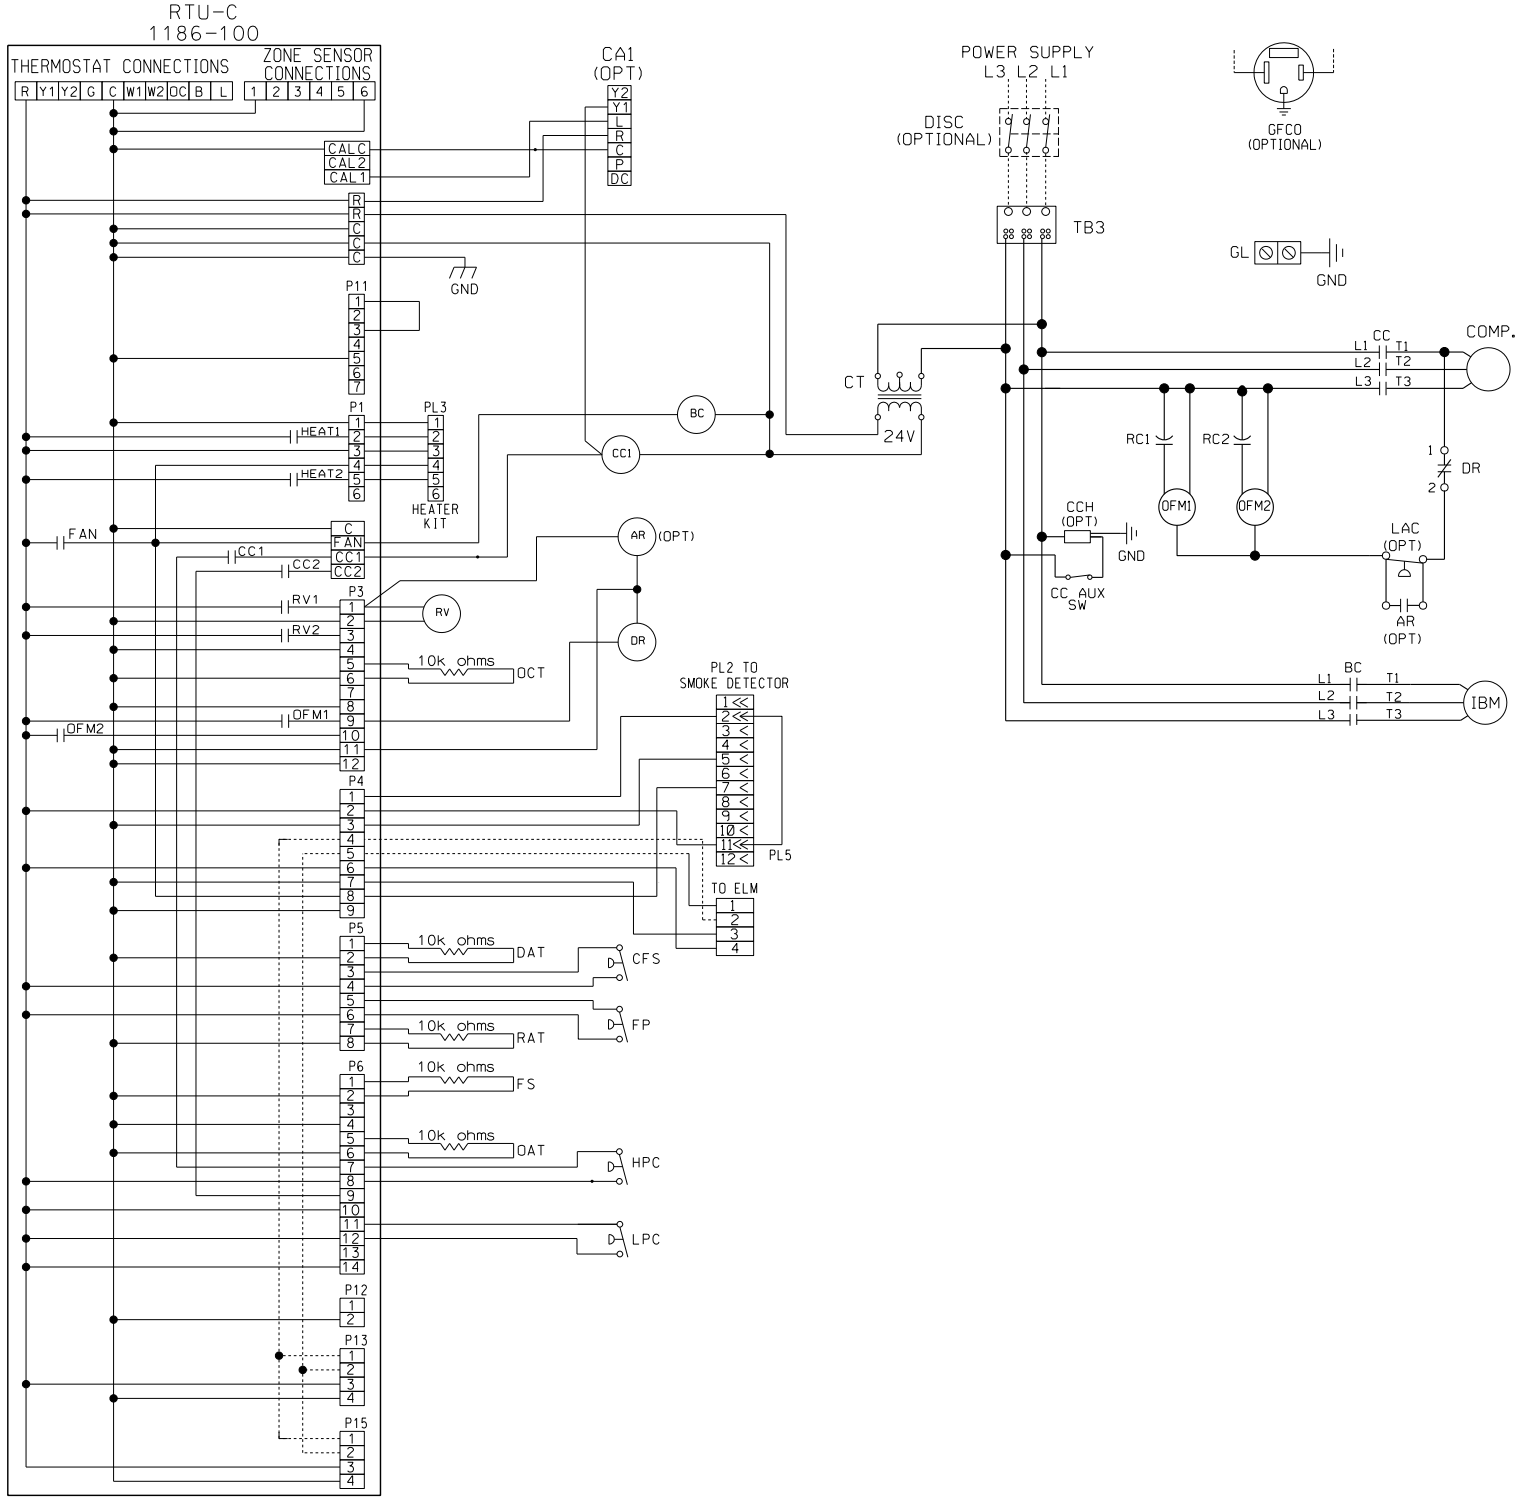



## COMPONENT CODE

| | |
|---|---|
| BC | BLOWER CONTACTOR |
| CA | COMFORT ALERT MODULE |
| CC | COMPRESSOR CONTACTOR |
| CCH | CRANKCASE HEATER |
| CFS | CLOGGED FILTER SWITCH |
| COMP | COMPRESSOR |
| CT | CONTROL TRANSFORMER |
| DISC | DISCONNECT SWITCH |
| FP | FAN PROVING |
| FS | FREEZE SENSOR |
| GFCO | GROUND FAULT CONVENIENCE OUTLET |
| GL | GROUND LUG |
| GND | GROUND |
| HPC | HIGH PRESSURE CONTROL |
| IBM | INDOOR BLOWER MOTOR BELT DRIVE |
| IFC | INTEGRATED FURNACE CONTROL |
| LAC | LOW AMBIENT COOLING CONTROL |
| LC | LIMIT CONTROL |
| LPC | LOW PRESSURE CONTROL |
| MAS | MIX AIR SENSOR |
| OAT | OUTSIDE AIR SENSOR |
| OFM | OUTDOOR FAN MOTOR |
| PL | PLUG |
| RAT | RETURN AIR SENSOR |
| RC | RUN CAPACITOR |
| SCC | SPACE COMFORT CONTROL |
| SE | SPARK ELECTRODE |
| TB | TERMINAL BLOCK |
| | WIRE NUT |

## WIRING INFORMATION

LINE VOLTAGE
- -FACTORY STANDARD ———
- -FACTORY OPTION -·-·-·-·-·-
- -FIELD INSTALLED ·····

LOW VOLTAGE
- -FACTORY STANDARD ———
- -FACTORY OPTION -·-·-·-·-·-
- -FIELD INSTALLED ·····

REPLACEMENT WIRE
- -MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105° C MIN.)

WARNING
- -CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C., AND LOCAL CODES AS APPLICABLE.

## WIRE COLOR CODE

| | | | |
|---|---|---|---|
| BK | BLACK | O | ORANGE |
| BR | BROWN | PR | PURPLE |
| BL | BLUE | R | RED |
| G | GREEN | W | WHITE |
| GY | GRAY | Y | YELLOW |

# WIRING SCHEMATIC
# RJNL-C090/120
208-230/460/575V 3 PH, 60 HZ.
PACKAGED A/C

| DR. BY | APP. BY | DATE | DWG. NO. | REV |
|---|---|---|---|---|
| MGR | | 7-16-09 | 90-103264-01 | 01 |