
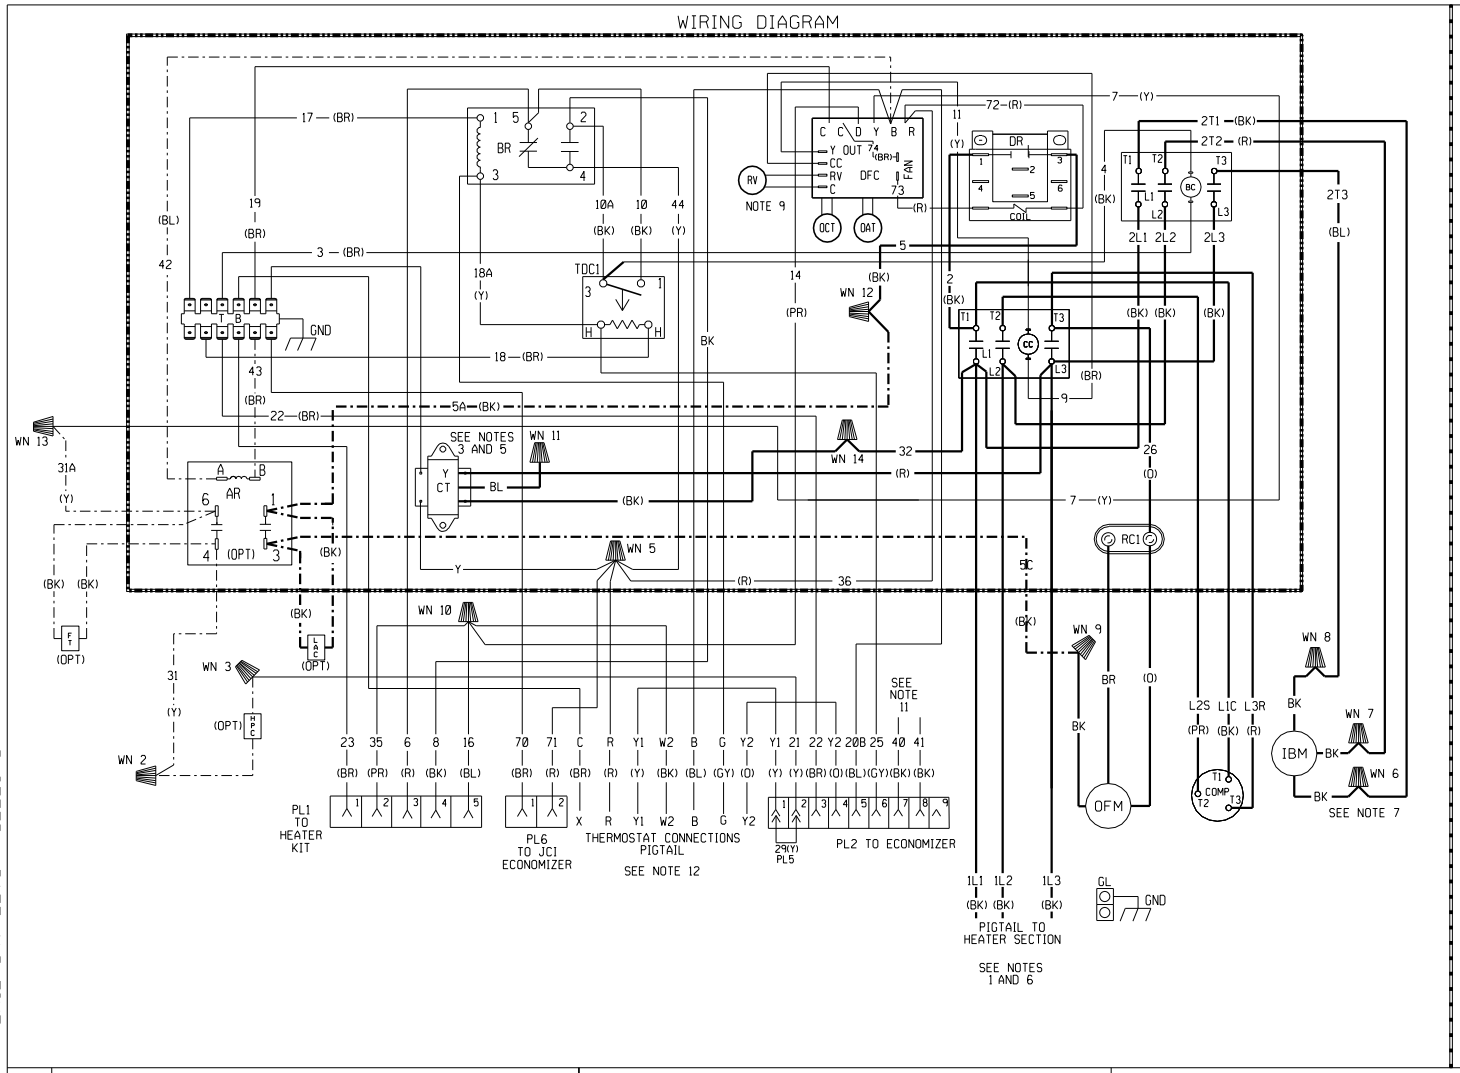


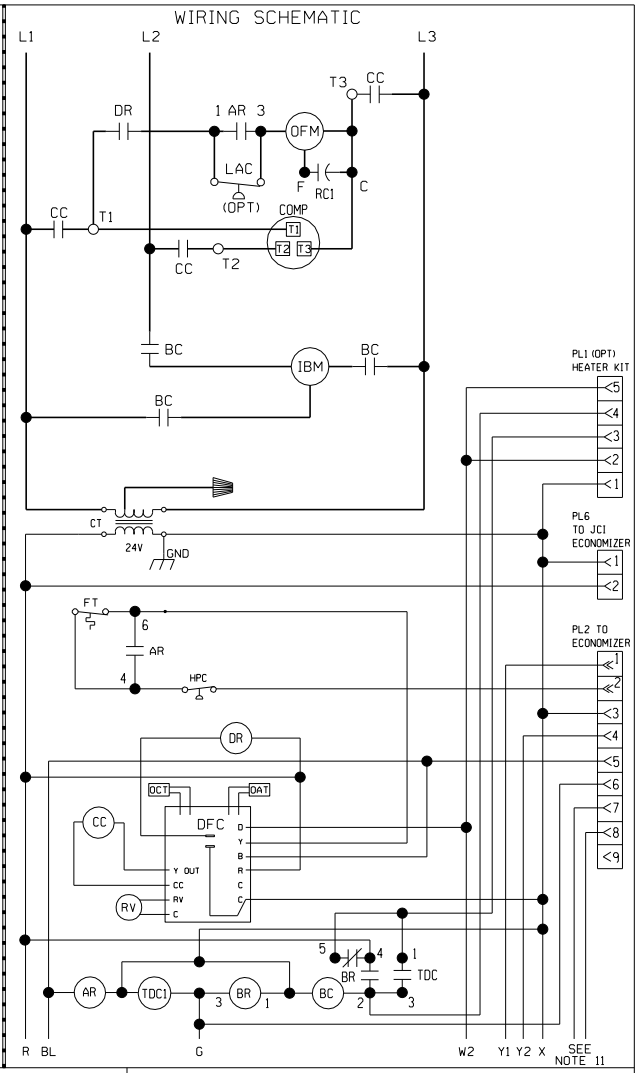

COMPONENT CODE

AR	ACCESSORY RELAY	OPT	OPTIONAL
BR	BLOWER RELAY	PL	PLUG
CC	COMPRESSOR CONTACTOR	RC	RUN CAPACITOR
COMP	COMPRESSOR	RV	REVERSING VALVE
CT	CONTROL TRANSFORMER	TB	TERMINAL BLOCK
DFC	DEFROST CONTROL	TDC	TIME DELAY CONTROL
DR	DEFROST RELAY	WN	WIRE NUT
FT	FREEZE STAT		
GL	GROUND LUG		
GND	GROUND		
HPC	HIGH PRESSURE CONTROL		
IBM	INDOOR BLOWER MOTOR		
LAC	LOW AMBIENT CONTROL		
OAT	OUTDOOR AMBIENT TEMP		
OCT	OUTDOOR COIL TEMP		
OFM	OUTDOOR FAN MOTOR		

NOTES:

1. CONNECTORS SUITABLE FOR USE WITH COPPER CONDUCTORS ONLY.
2. COMPRESSOR MOTOR THERMALLY PROTECTED. ALL 3 PHASE MODELS ARE PROTECTED UNDER PRIMARY SINGLE PHASE CONDITIONS.
3. CONTROL TRANSFORMER PRIMARY LEADS:
   60 HZ.
   RED-COM., BLUE-208V., BLACK-230V., BLACK/RED-460V., BLACK/BLUE-575V. TRANSFORMER FACTORY WIRED FOR 230 VOLTS ON "J" & "C" MODELS. INTERCHANGE BLACK & BLUE LEADS FOR 208 VOLT OPERATION. 460 & 575 VOLTS MODELS FACTORY WIRED FOR CORRECT VOLTAGE.
   50 HZ.
   ORANGE-COMMON, BLUE-380V, BLACK-415V.
4. CONTACTOR FACTORY WIRED. CONNECT FIELD WIRE TO FACTORY SUPPLIED CONTACTOR WIRES IN ELECTRICAL BOX.
5. LOW VOLTAGE CIRCUIT IS N.E.C. CLASS 2 WITH A CLASS 2 TRANSFORMER, 24V. 50/60 HZ SUPPLIED.
6. CONNECT FIELD WIRING IN GROUNDED RAIN TIGHT CONDUIT TO 60 HZ FUSED DISCONNECT.
7. MOTOR FACTORY WIRED FOR CORRECT SPEED.
8. SEE FUSE LABEL ON UNIT FUSE BOX FOR FUSE SIZING AND CLASSIFICATION.
9. REVERSING VALVE ENERGIZED IN HEATING.
10. ALL SWITCHES ARE SHOWN IN COOLING POSITION.
11. WIRES FROM PL2 (7 & 8) GO TO THE MIXED AIR SENSOR ON THE OPTIONAL ECONOMIZER.
12. Y2 IS USED ONLY FOR THE OPTIONAL ECONOMIZER.

WIRING INFORMATION

LINE VOLTAGE
- -FACTORY STANDARD ——————
- -FACTORY OPTION —·—·—·—
- -FIELD INSTALLED - - - - -

LOW VOLTAGE
- -FACTORY STANDARD ——————
- -FACTORY OPTION —·—·—·—
- -FIELD INSTALLED - - - - -

REPLACEMENT WIRE
- -MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105 C°MIN.)

WARNING
- -CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C. AND LOCAL CODES AS APPLICABLE.

WIRE COLOR CODE

BK	BLACK	GY	GRAY	R	RED
BR	BROWN	O	ORANGE	W	WHITE
BL	BLUE	PK	PINK	Y	YELLOW
G	GREEN	PR	PURPLE		

ELECTRICAL WIRING DIAGRAM
460, 3 PHASE
BELT DRIVE
HEAT PUMP
3 - 5 TON

DR. BY	APP. BY	DATE	DWG. NO.	REV
MCB		6-01-05	90-23595-15	05

DWG. NO. 90-23595-15 REV 05