
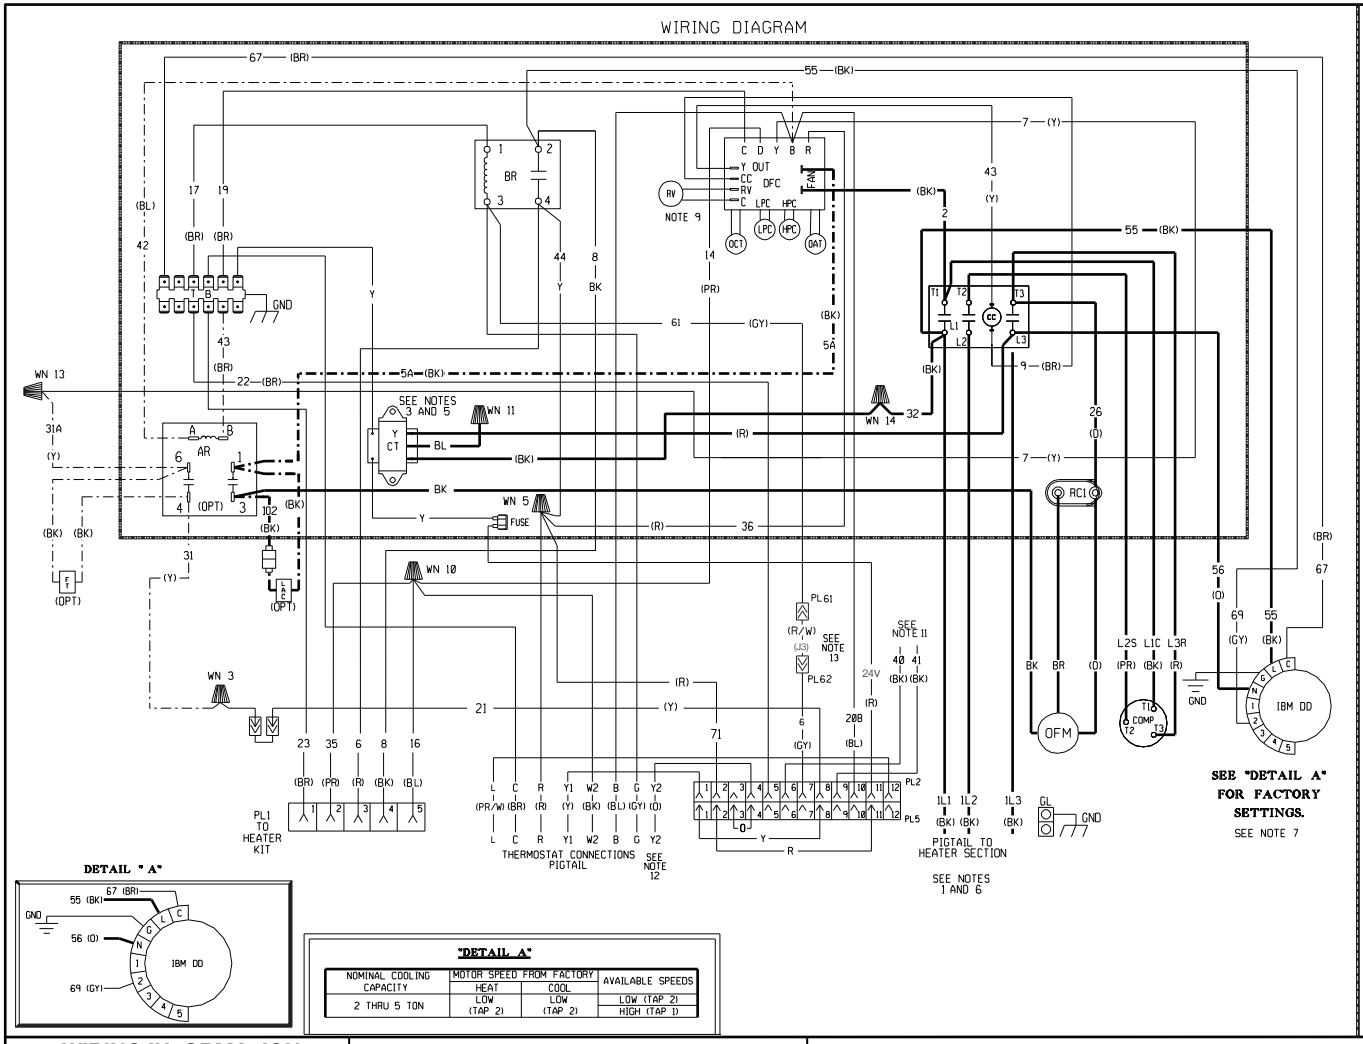


"DETAIL A"

NOMINAL COOLING CAPACITY	MOTOR SPEED FROM FACTORY		AVAILABLE SPEEDS
	HEAT	COOL	
2 THRU 5 TON	LOW (TAP 2)	LOW (TAP 2)	LOW (TAP 2)
			HIGH (TAP 1)

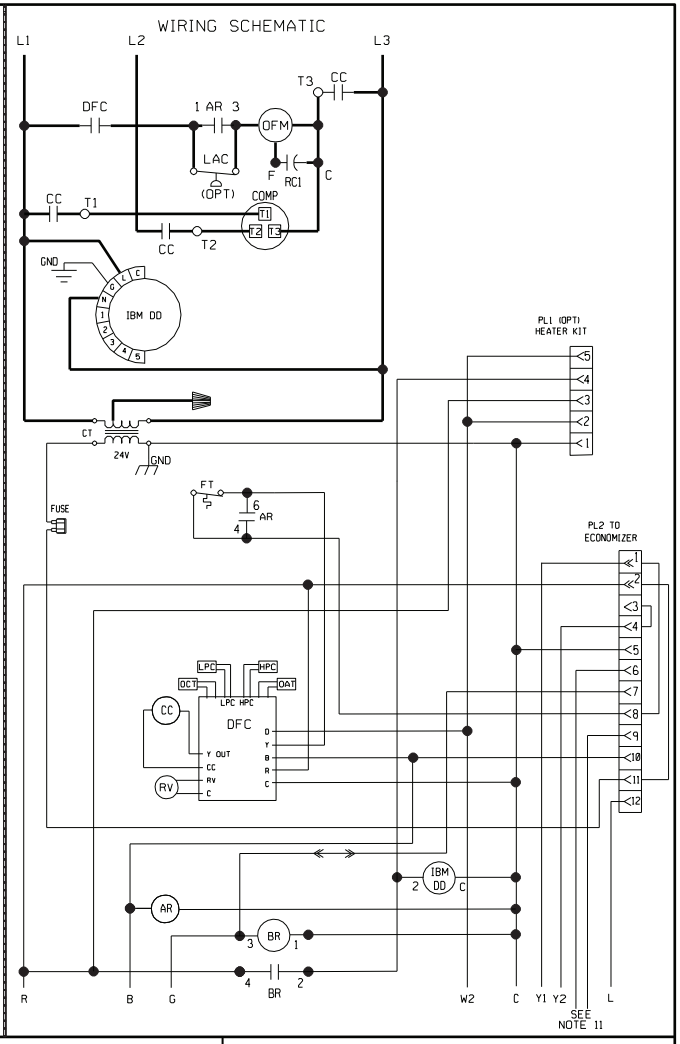

WIRING INFORMATION

LINE VOLTAGE
-FACTORY STANDARD ——————
-FACTORY OPTION —·—·—·—·—
-FIELD INSTALLED - - - - - -

LOW VOLTAGE
-FACTORY STANDARD ——————
-FIELD INSTALLED - - - - - -

REPLACEMENT WIRE
-MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105C. MIN.)

WARNING
-CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C., NATIONAL WIRING REGULATIONS, AND LOCAL CODES AS APPLICABLE.

NOTES

1. CONNECTORS SUITABLE FOR USE WITH COPPER CONDUCTORS ONLY.
2. COMPRESSOR MOTOR THERMALLY PROTECTED. ALL 3 PHASE MODELS ARE PROTECTED UNDER PRIMARY SINGLE PHASE CONDITIONS.
3. CONTROL TRANSFORMER PRIMARY LEADS: RED-COM., BLUE-208V., BLACK-230V.. TRANSFORMER FACTORY WIRED FOR 230 VOLTS ON "J" & "C" MODELS. INTERCHANGE BLACK & BLUE LEADS FOR 208 VOLT OPERATION.
4. CONTACTOR FACTORY WIRED. CONNECT FIELD WIRE TO FACTORY SUPPLIED CONTACTOR IN ELECTRICAL BOX.
5. LOW VOLTAGE CIRCUIT IS N.E.C. CLASS 2 WITH A CLASS 2 TRANSFORMER. 24V, 50/60 HZ SUPPLIED.
6. CONNECT FIELD WIRING IN GROUNDED RAIN TIGHT CONDUIT TO 60 HZ FUSED DISCONNECT.
7. MOTOR FACTORY WIRED FOR CORRECT SPEED.
8. SEE FUSE LABEL ON UNIT FUSE BOX FOR FUSE SIZING AND CLASSIFICATION.
9. REVERSING VALVE ENERGIZED IN HEATING.
10. ALL SWITCHES ARE SHOWN IN COOLING POSITION.
11. WIRES FROM PL2 (6 & 9) GO TO THE MIXED AIR SENSOR ON THE OPTIONAL ECONOMIZER.
12. Y2 IS USED ONLY FOR THE OPTIONAL ECONOMIZER.
13. REMOVE JUMPER FOR FIELD INSTALLED OCCUPANCY RELAY.

COMPONENT CODES

AR	ACCESSORY RELAY	LAC	LOW AMBIENT COOLING CONTROL
BR	BLOWER RELAY	LPC	LOW PRESSURE CONTROL
CC	COMPRESSOR CONTACTOR	OAT	OUTDOOR AMBIENT TEMP
COMP	COMPRESSOR	OCT	OUTDOOR COIL TEMP
CT	CONTROL TRANSFORMER	OFM	OUTDOOR FAN MOTOR
DFC	DEFROST CONTROL	OPT	OPTIONAL
DR	DEFROST RELAY	PL	PLUG
FT	FREEZE STAT	RC	RUN CAPACITOR
GL	GROUND LUG	RV	REVERSING VALVE
GND	GROUND	TB	TERMINAL BLOCK
HPC	HIGH PRESSURE CONTROL	TDC	TIME DELAY CONTROL
IBM	INDOOR BLOWER MOTOR DIRECT DRIVE	WN	WIRE NUT

WIRE COLOR CODE

BK.....BLACK	G.....GREEN	PR.....PURPLE
BR.....BROWN	GY.....GRAY	R.....RED
BL.....BLUE	O.....ORANGE	W.....WHITE
		Y.....YELLOW

ELECTRICAL WIRING DIAGRAM

208 / 230, 3 PHASE
DIRECT DRIVE / X-MOTOR
HEAT PUMP

APPROVED:		CHECKED:	ORIGINAL RELEASE NO.:
MODELED BY:	MGR	DATE: 7-20-10	Q-0011S002
PART NO.:	90-23595-35		REV: 02