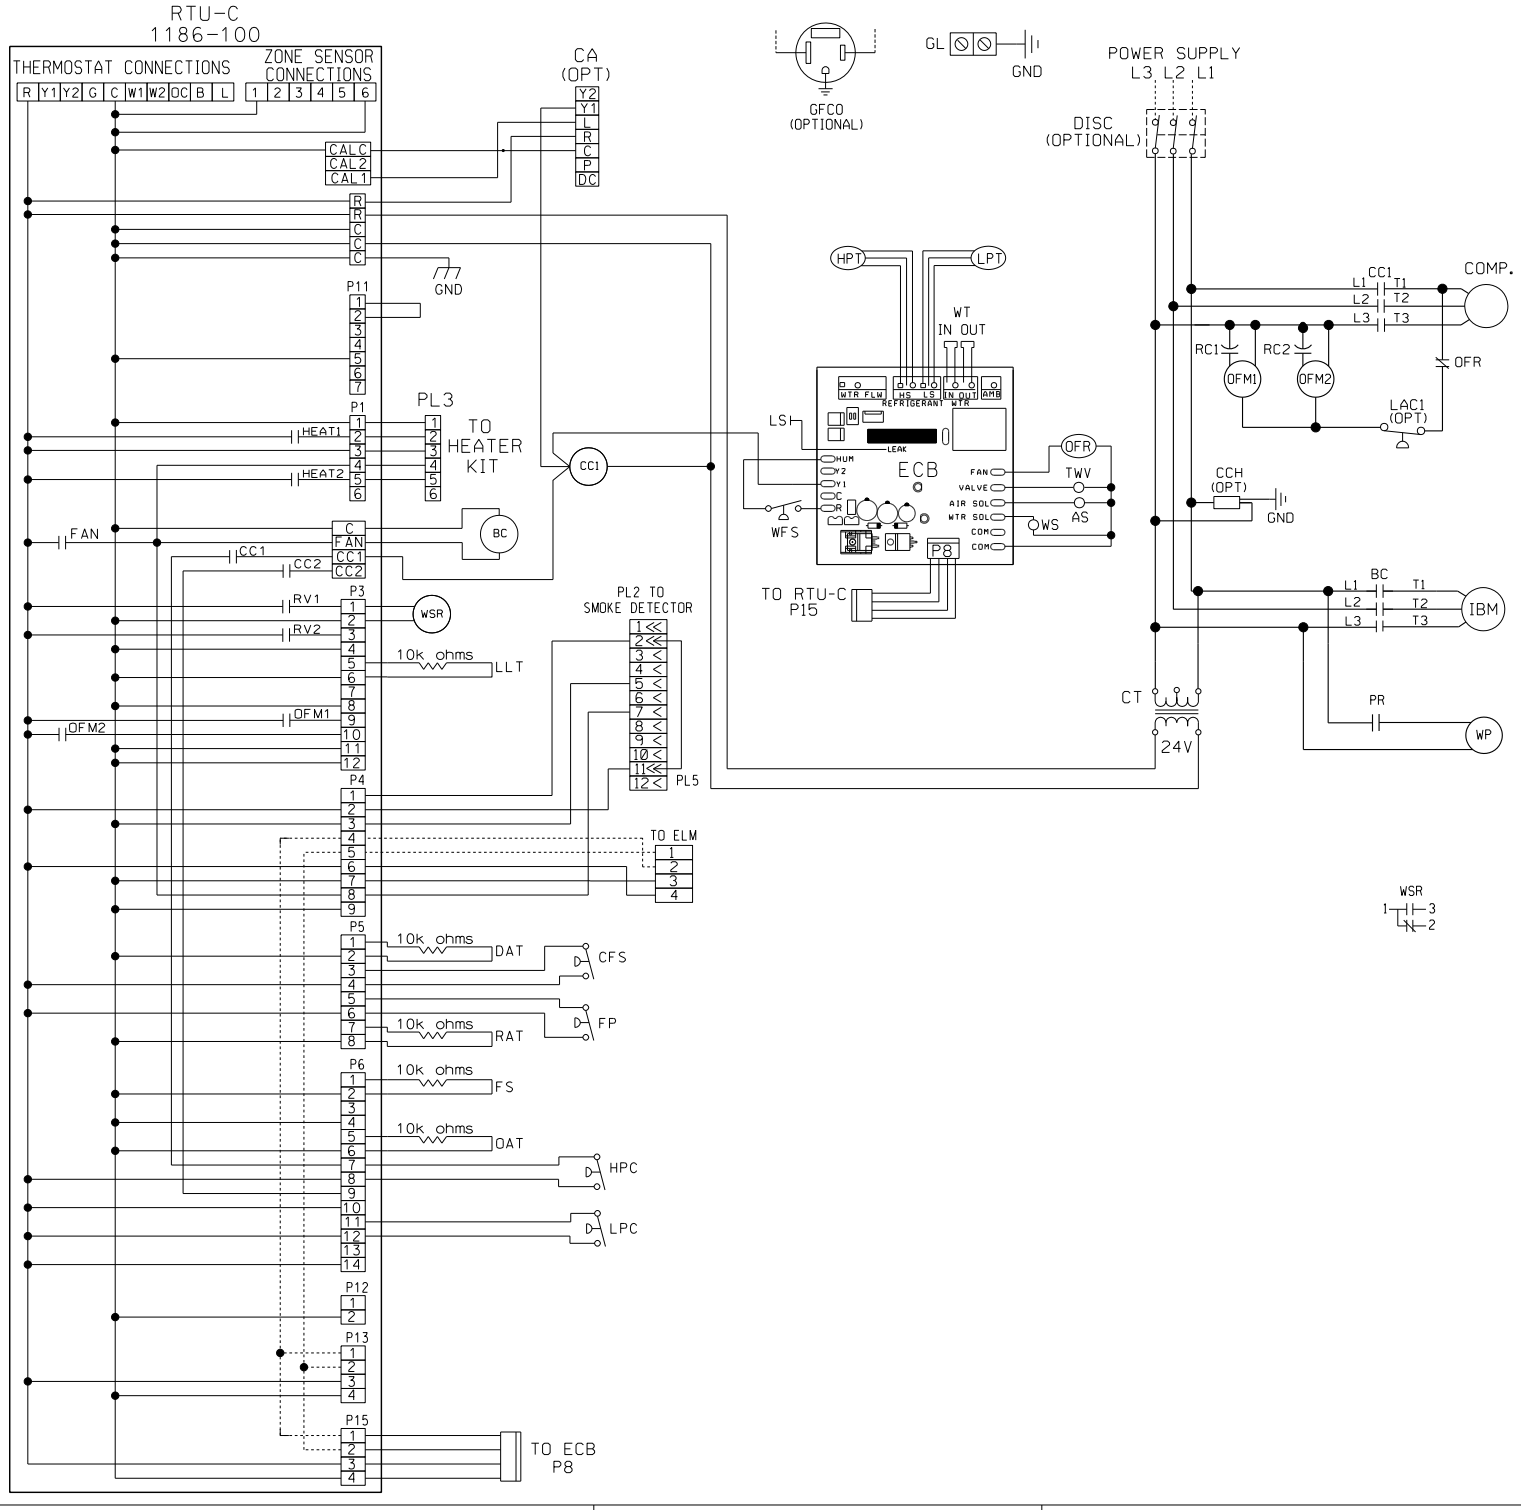


COMPONENT CODE

AS	AIR SOLENOID	LAC	LOW AMBIENT COOLING CONTROL
BC	BLOWER CONTACTOR	LC	LIMIT CONTROL
CA	COMFORT ALERT MODULE	LLT	LIQUID LINE TEMPERATURE
CC	COMPRESSOR CONTACTOR	LPC	LOW PRESSURE CONTROL
CCH	CRANKCASE HEATER	LPT	LOW PRESSURE TRANSDUCER
CFS	CLOGGED FILTER SWITCH	LS	LEAK SENSOR
COMP	COMPRESSOR	OAT	OUTSIDE AIR SENSOR
CT	CONTROL TRANSFORMER	OFM	OUTDOOR FAN MOTOR
DAT	DISCHARGE AIR SENSOR	OFR	OUTDOOR FAN RELAY
DISC	DISCONNECT SWITCH	PL	PLUG
ECB	eSYNC CONTROL BOARD	RAT	RETURN AIR SENSOR
ELM	ECONOMIZER LOGIC MODULE	RC	RUN CAPACITOR
FP	FAN PROVING	RTU-C	ROOFTOP UNIT CONTROL
FS	FREEZE SENSOR	TB	TERMINAL BLOCK
GFCO	GROUND FAULT CONVENIENCE OUTLET	WFS	WATER FLOW SWITCH
GL	GROUND LUG	WP	WATER PUMP
GND	GROUND	WS	WATER SOLENOID
GV	GAS VALVE	WSR	WATER SHUTOFF RELAY
HPC	HIGH PRESSURE CONTROL	WT	WATER TEMPERATURE SENSOR
HPT	HIGH PRESSURE TRANSFORMER		WIRE NUT
IBM	INDOOR BLOWER MOTOR BELT DRIVE		

WIRING INFORMATION

LINE VOLTAGE
- -FACTORY STANDARD ——————
- -FACTORY OPTION -·-·-·-·-·-
- -FIELD INSTALLED ··········

LOW VOLTAGE
- -FACTORY STANDARD ——————
- -FACTORY OPTION -·-·-·-·-·-
- -FIELD INSTALLED ··········

REPLACEMENT WIRE
- -MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105° C MIN.)

WARNING
- -CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C., AND LOCAL CODES AS APPLICABLE.

WIRE COLOR CODE

BK	BLACK	O	ORANGE
BR	BROWN	PR	PURPLE
BL	BLUE	R	RED
G	GREEN	W	WHITE
GY	GRAY	Y	YELLOW

WIRING SCHEMATIC

?LHL-C12ØC

208-230V 3 PH, 60 HZ.

PACKAGE A/C W/RTU-C

DR. BY	APP. BY	DATE	DWG. NO.	REV
MGR		1-28-10	90-103246-15	Ø3