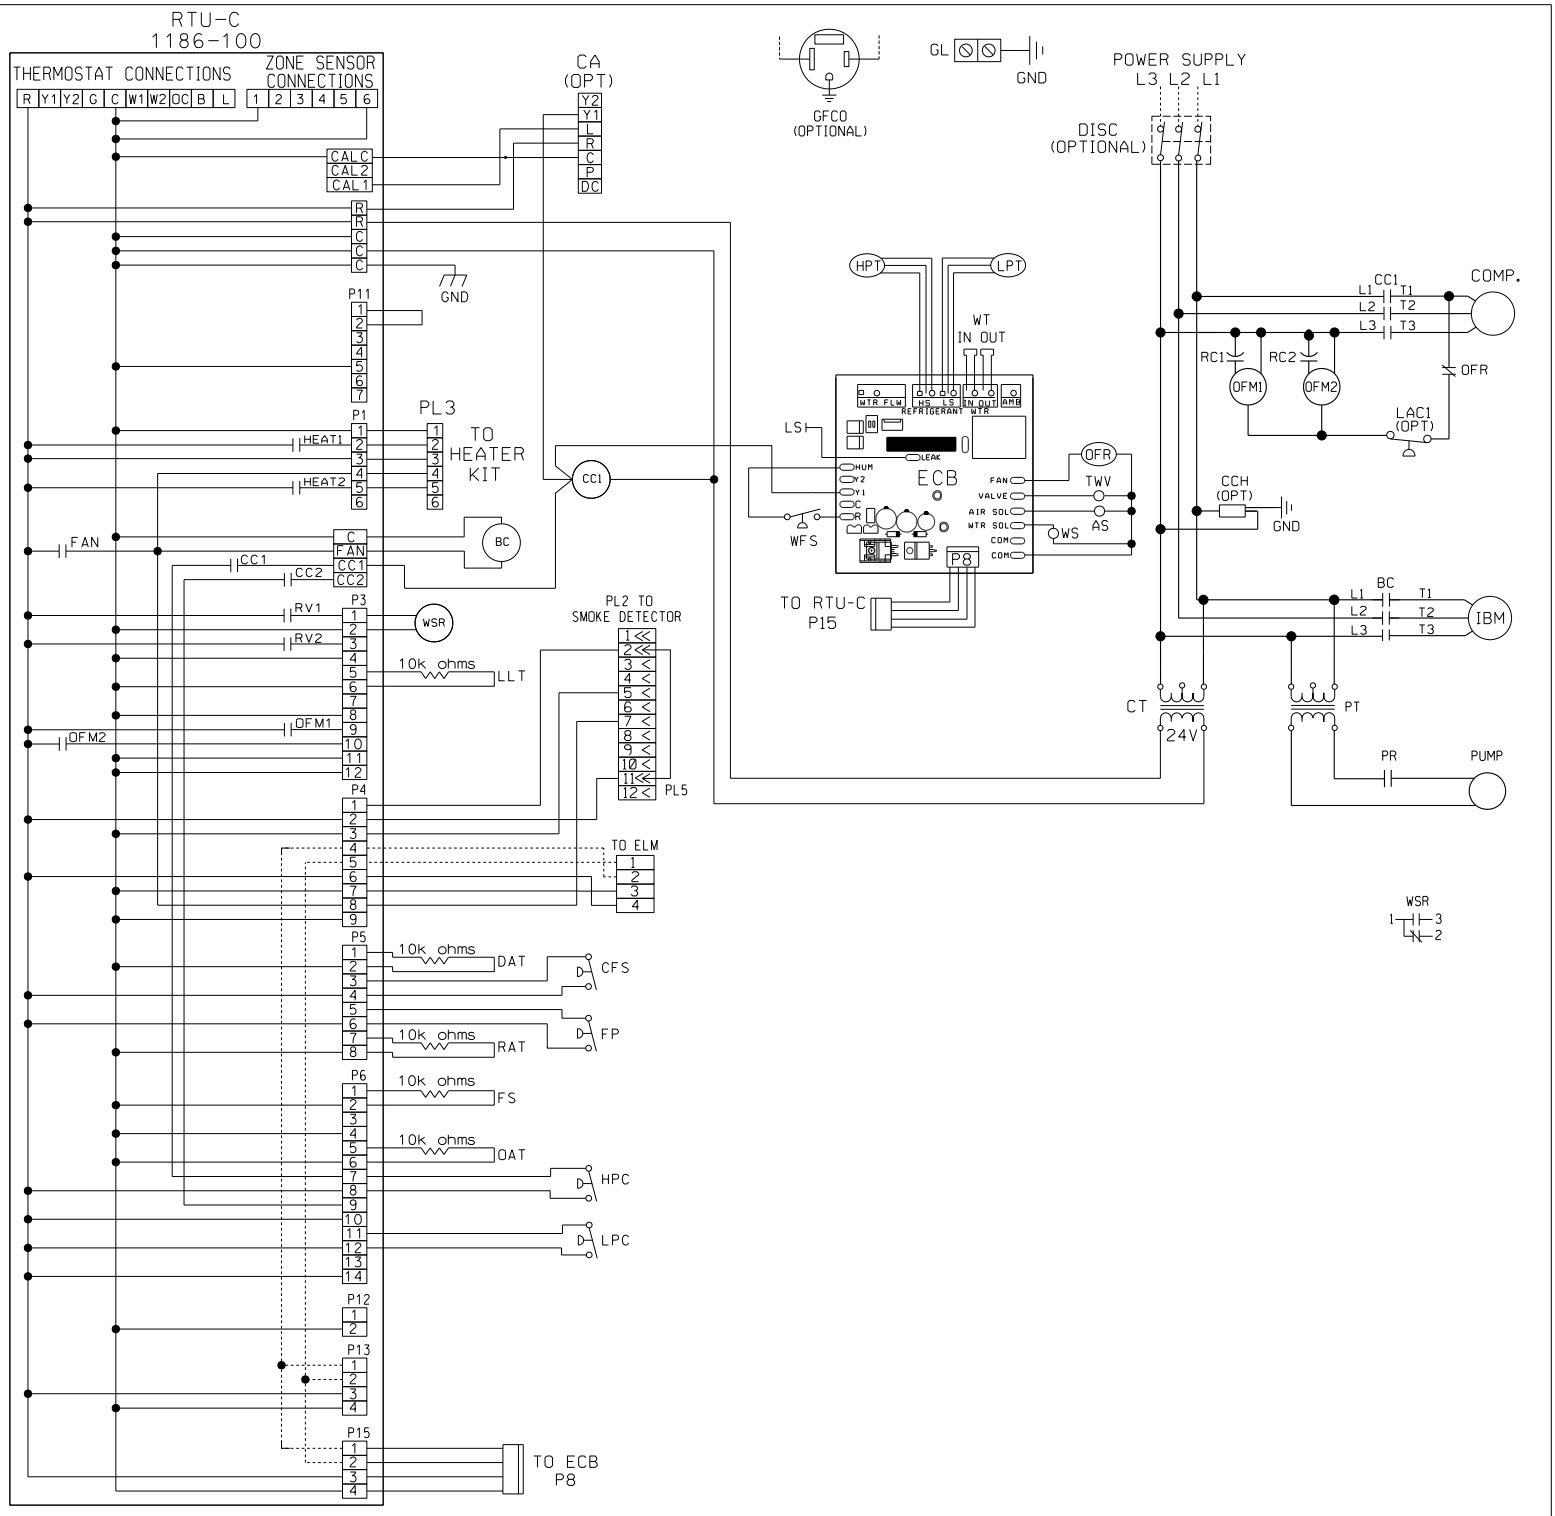


COMPONENT CODE

AS	AIR SOLENOID
BC	BLOWER CONTACTOR
CA	COMFORT ALERT MODULE
CC	COMPRESSOR CONTACTOR
CCH	CRANKCASE HEATER
CFS	CLOGGED FILTER SWITCH
COMP	COMPRESSOR
CT	CONTROL TRANSFORMER
DAT	DISCHARGE AIR SENSOR
DISC	DISCONNECT SWITCH
ECB	eSYNC CONTROL BOARD
ELM	ECONOMIZER LOGIC MODULE
FP	FAN PROVING
FS	FREEZE SENSOR
GFCO	GROUND FAULT CONVENIENCE OUTLET
GL	GROUND LUG
GND	GROUND
HPC	HIGH PRESSURE CONTROL
HPT	HIGH PRESSURE TRANSFORMER
IBM	INDOOR BLOWER MOTOR BELT DRIVE
LAC	LOW AMBIENT COOLING CONTROL
LLT	LIQUID LINE TEMPERATURE
LPC	LOW PRESSURE CONTROL
LPT	LOW PRESSURE TRANSDUCER
LS	LEAK SENSOR
OAT	OUTSIDE AIR SENSOR
OFM	OUTDOOR FAN MOTOR
OFR	OUTDOOR FAN RELAY
PL	PLUG
PR	PUMP RELAY
PT	POWER TRANSFORMER
RAT	RETURN AIR SENSOR
RC	RUN CAPACITOR
RTU-C	ROOFTOP UNIT CONTROL
TB	TERMINAL BLOCK
WFS	WATER FLOW SWITCH
WP	WATER PUMP
WS	WATER SOLENOID
WSR	WATER SHUTOFF RELAY
WT	WATER TEMPERATURE SENSOR
⚠	WIRE NUT

WIRING INFORMATION

LINE VOLTAGE
- -FACTORY STANDARD ——————
- -FACTORY OPTION -·-·-·-·-·-·-
- -FIELD INSTALLED ··········

LOW VOLTAGE
- -FACTORY STANDARD ——————
- -FACTORY OPTION -·-·-·-·-·-·-
- -FIELD INSTALLED ··········

REPLACEMENT WIRE
- -MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105° C MIN.)

WARNING
- -CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C., AND LOCAL CODES AS APPLICABLE.

WIRE COLOR CODE

BK	BLACK	O	ORANGE
BR	BROWN	PR	PURPLE
BL	BLUE	R	RED
G	GREEN	W	WHITE
GY	GRAY	Y	YELLOW

WIRING SCHEMATIC

?LHL-C120D

460V 3 PH, 60 HZ.

PACKAGE A/C W/RTU-C

DR. BY	APP. BY	DATE	DWG. NO.	REV
MGR		1-28-11	90-103246-17	03