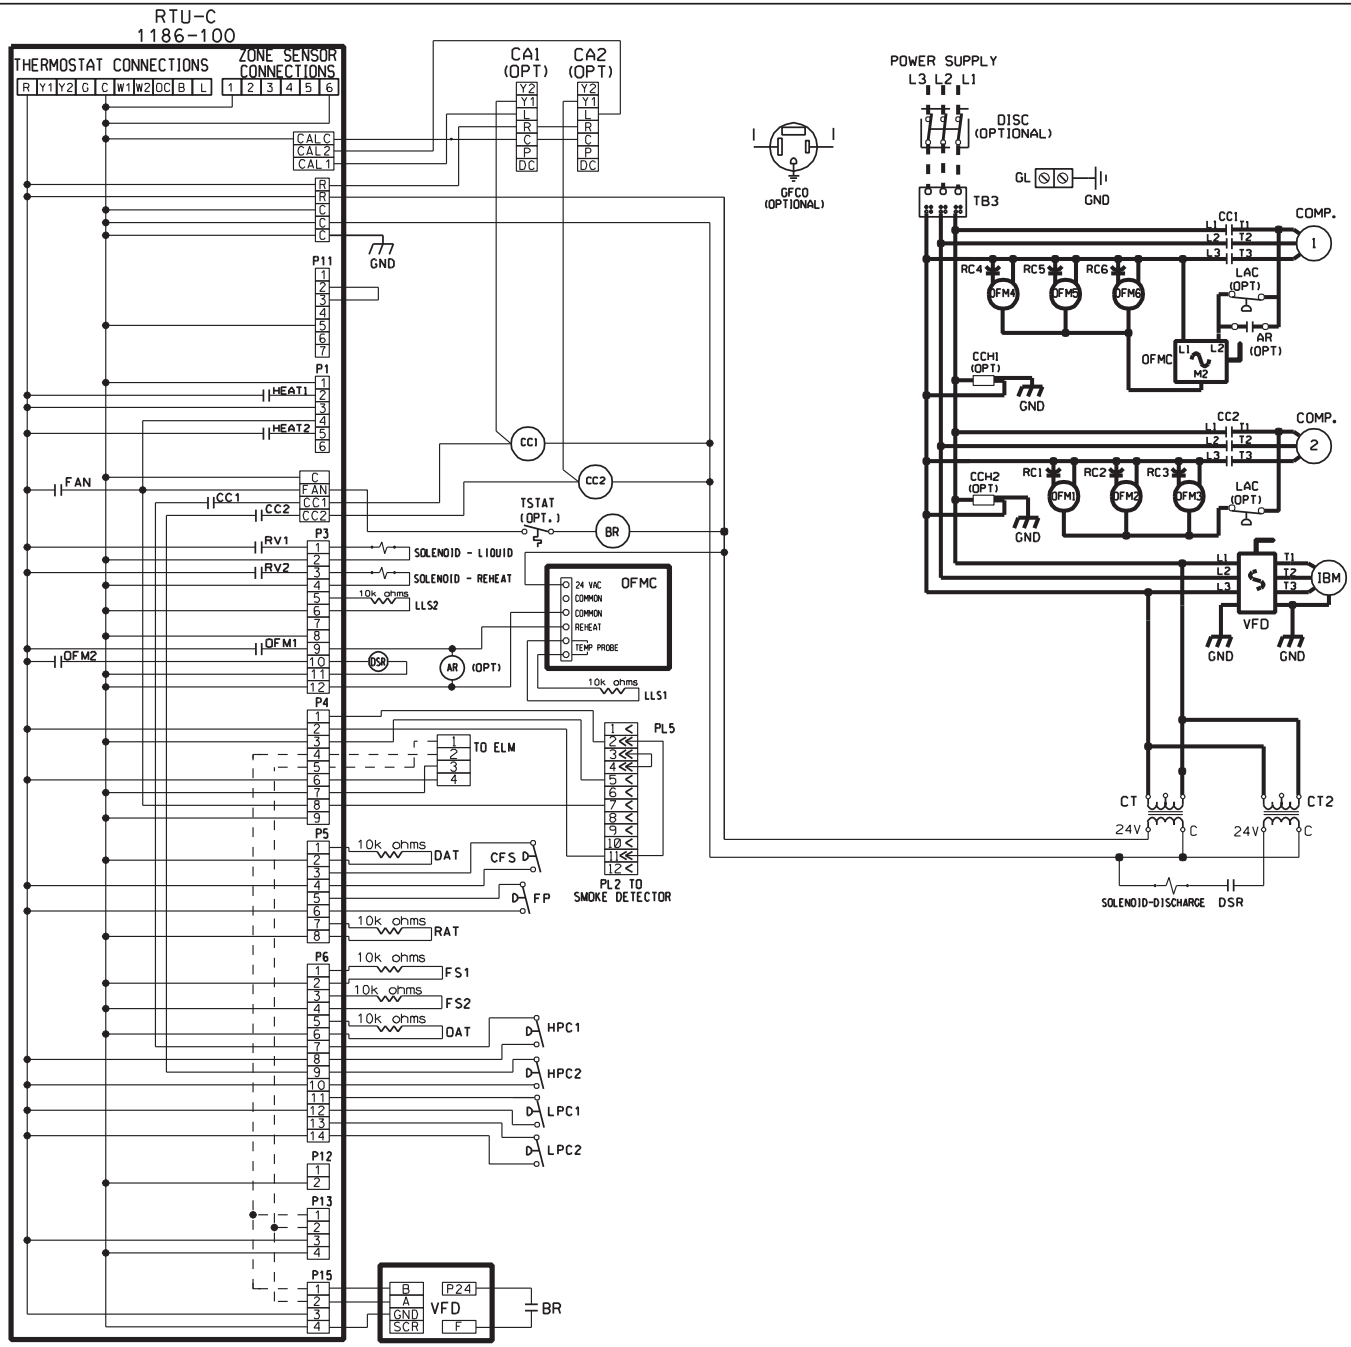



## COMPONENT CODE

| | |
|---|---|
| AR | ACCESSORY RELAY |
| BR | BLOWER RELAY |
| CA | COMFORT ALERT MODULE |
| CC | COMPRESSOR CONTACTOR |
| CCH | CRANKCASE HEATER |
| CFS | CLOGGED FILTER SWITCH |
| COMP | COMPRESSOR |
| CT | CONTROL TRANSFORMER |
| DAT | DISCHARGE AIR SENSOR |
| DSR | DISCHARGE SOLENOID RELAY |
| DISC | DISCONNECT SWITCH |
| FP | FAN PROVING |
| FS | FREEZE SENSOR |
| GFCO | GROUND FAULT CONVENIENCE OUTLET |
| GL | GROUND LUG |
| GND | GROUND |
| HPC | HIGH PRESSURE CONTROL |
| IBM | INDOOR BLOWER MOTOR BELT DRIVE |
| IFC | INTEGRATED FURNACE CONTROL |
| LAC | LOW AMBIENT COOLING CONTROL |
| LC | LIMIT CONTROL |
| LLS | LIQUID LINE SENSOR |
| LPC | LOW PRESSURE CONTROL |
| OAT | OUTSIDE AIR SENSOR |
| OFM | OUTDOOR FAN MOTOR |
| OFMC | OUTDOOR FAN MOTOR CONTROLLER |
| PL | PLUG |
| RAT | RETURN AIR SENSOR |
| RC | RUN CAPACITOR |
| RTU-C | ROOFTOP UNIT CONTROL |
| TB | TERMINAL BLOCK |
| VFD | VARIABLE FREQUENCY DRIVE |
| | WIRE NUT |

## WIRING INFORMATION

LINE VOLTAGE
- -FACTORY STANDARD
- -FACTORY OPTION
- -FIELD INSTALLED

LOW VOLTAGE
- -FACTORY STANDARD
- -FACTORY OPTION
- -FIELD INSTALLED

REPLACEMENT WIRE
- -MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105° C MIN.)

WARNING
- -CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C., AND LOCAL CODES AS APPLICABLE.

## WIRE COLOR CODE

| | |
|---|---|
| BK__BLACK | O___ORANGE |
| BR__BROWN | PR__PURPLE |
| BL__BLUE | R___RED |
| G___GREEN | W___WHITE |
| GY__GRAY | Y___YELLOW |

# WIRING SCHEMATIC
## REHEAT 180/240/300
### 208-230/460V 3 PH, 60 HZ.
### ROOFTOP W/RTU-C

| DR. BY | APP. BY | DATE | DWG. NO. | REV |
|---|---|---|---|---|
| MCB | | 10-21-11 | 90-103263-05 | 01 |