

WIRING DIAGRAM

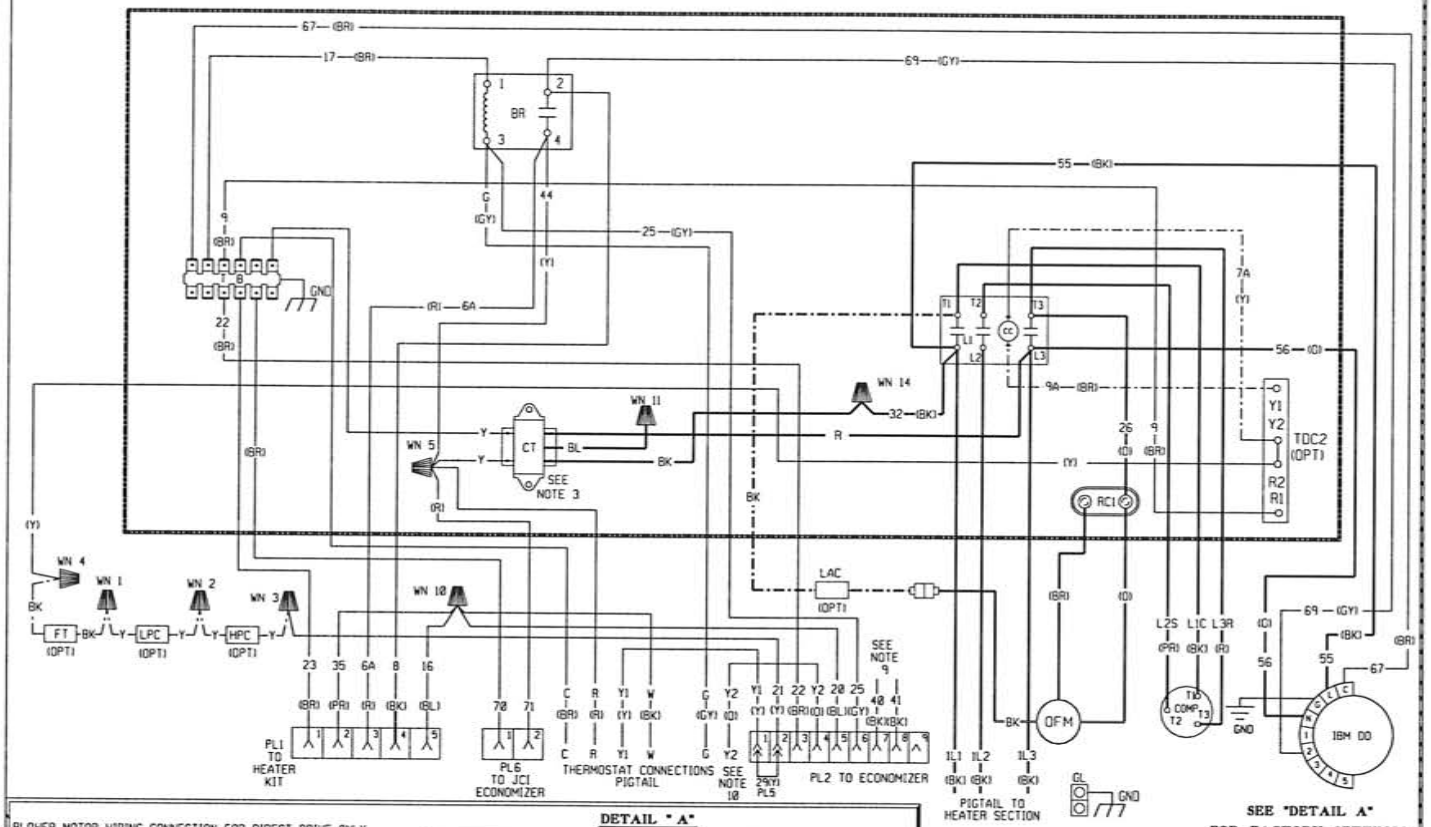


BLOWER MOTOR WIRING CONNECTION FOR DIRECT DRIVE ONLY



DETAIL "A"

NOMINAL COOLING CAPACITY	MOTOR SPEED FROM FACTORY		AVAILABLE SPEEDS
	HEAT	COOL	
3 TON	LOW (TAP 2)	LOW (TAP 2)	LOW (TAP 2)
			MED (TAP 3)
			HIGH (TAP 4)
3.5, 4 TON	MED (TAP 2)	MED (TAP 2)	LOW (TAP 1)
			MED (TAP 2)
			MED (TAP 3)
			HIGH (TAP 4)
5 TON	MED (TAP 2)	MED (TAP 2)	LOW (TAP 1)
			MED (TAP 2)
			HIGH (TAP 3)

WIRING SCHEMATIC

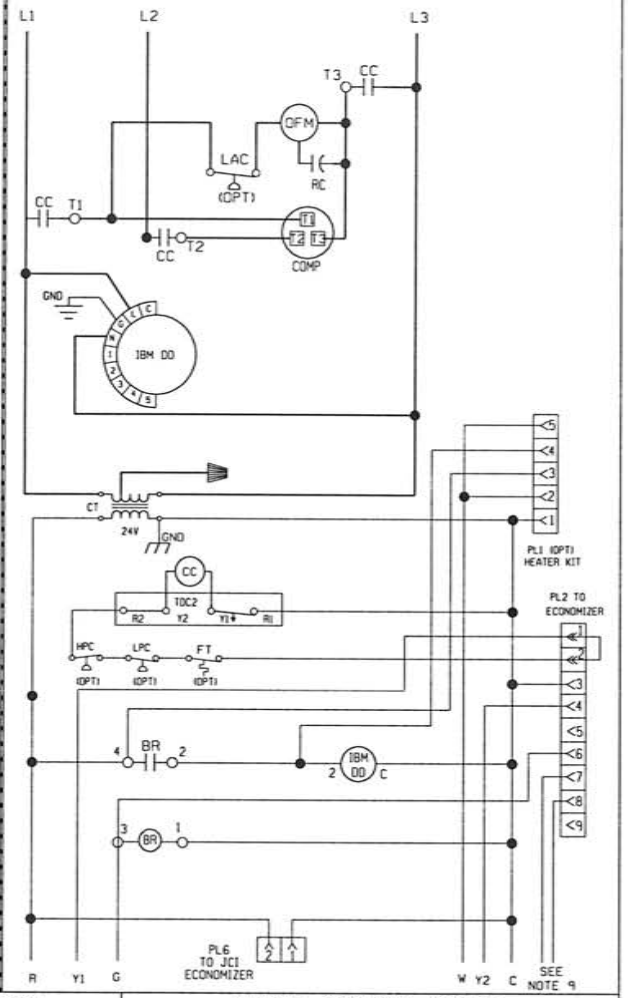

COMPONENT CODE

BR	BLOWER RELAY
CC	COMPRESSOR CONTACTOR
COMP	COMPRESSOR
CT	CONTROL TRANSFORMER
FT	FREEZE STAT
GL	GROUND LUG
GND	GROUND
HPC	HIGH PRESSURE CONTROL
IBMDD	INDOOR BLOWER MOTOR DIRECT DRIVE
LAC	LOW AMBIENT COOLING CONTROL
LPC	LOW PRESSURE CONTROL
OFM	OUTDOOR FAN MOTOR
PL	PLUG
RC	RUN CAPACITOR
TB	TERMINAL BLOCK (LOW VOLTAGE)
TDC	TIME DELAY CONTROL
WN	WIRE NUT

NOTES:

1. CONNECTORS SUITABLE FOR USE WITH COPPER CONDUCTORS ONLY.
2. COMPRESSOR MOTOR THERMALLY PROTECED. ALL 3 PHASE MODELS ARE PROTECTED UNDER PRIMARY SINGLE PHASE CONDITIONS.
3. CONTROL TRANSFORMER PRIMARY LEADS:
   60 HZ.
   RED-COM., BLUE-208V., BLACK-230V., BLACK/RED-460V., BLACK/BLUE-575V. TRANSFORMER FACTORY WIRED FOR 230 VOLTS ON "J" & "C" MODELS. INTERCHANGE BLACK & BLUE LEADS FOR 208 VOLT OPERATION. 460 & 575 VOLTS MODELS FACTORY WIRED FOR CORRECT VOLTAGE.
   50 HZ.
   ORANGE-COMMON, BLUE-380V, BLACK-415V.
4. CONTACTOR FACTORY WIRED. CONNECT FIELD WIRE TO FACTORY SUPPLIED PIGTAIL.
5. LOW VOLTAGE CIRCUIT IS N.E.C. CLASS 2 WITH A CLASS 2 TRANSFORMER, 24V,50/60 HZ SUPPLIED.
6. CONNECT FIELD WIRING IN GROUNDED RAIN TIGHT CONDUIT TO 60 HZ FUSED DISCONNECT.
7. MOTOR FACTORY WIRED FOR CORRECT SPEED.
8. SEE FUSE LABEL ON UNIT FUSE BOX FOR FUSE SIZING AND CLASSIFICATION.
9. WIRES FROM PL2 (7 & 8) GO TO THE MIXED AIR SENSOR ON THE OPTIONAL ECONOMIZER.
10. Y2 IS USED ONLY FOR THE OPTIONAL ECONOMIZER.

WIRING INFORMATION

LINE VOLTAGE
- -FACTORY STANDARD ——————
- -FACTORY OPTION —·—·—·—·—
- -FIELD INSTALLED - - - - - - -

LOW VOLTAGE
- -FACTORY STANDARD ——————
- -FACTORY OPTION —·—·—·—·—
- -FIELD INSTALLED - - - - - - -

REPLACEMENT WIRE
- -MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105 C°MIN.)

WARNING
- -CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C. AND LOCAL CODES AS APPLICABLE.

WIRE COLOR CODE

BK__BLACK	GY__GRAY	R___RED
BR__BROWN	O___ORANGE	W___WHITE
BL__BLUE	PK__PINK	Y___YELLOW
G___GREEN	PR__PURPLE	

ELECTRICAL WIRING DIAGRAM
208 / 230 / 460V, 3 PHASE DIRECT DRIVE/X-MOTOR PACKAGE AIR CONDITIONER

DR. BY	APP. BY	DATE	DWG. NO.	REV
MCB	MEB	5-2-05	90-23597-12	04