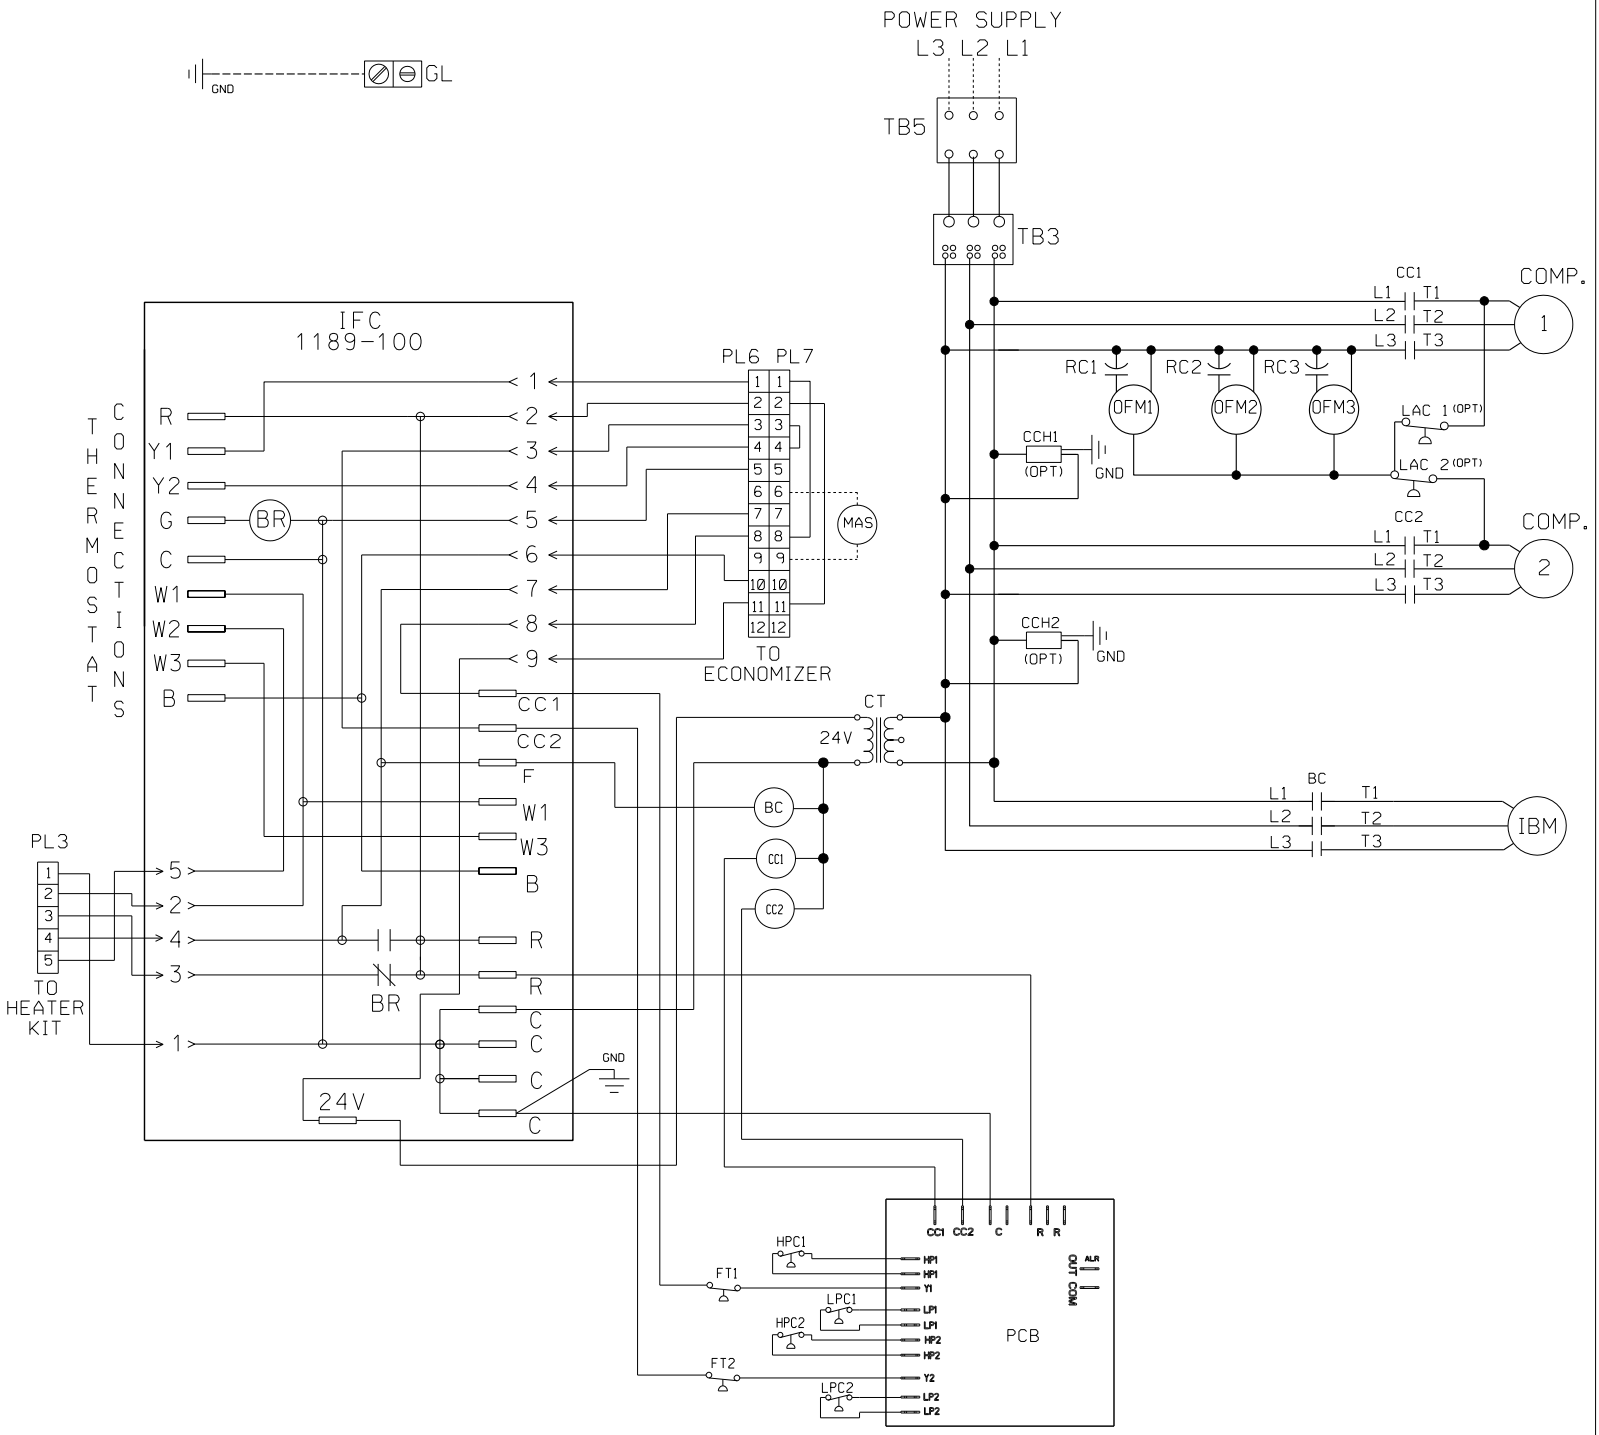


COMPONENT CODE

BC	BLOWER MOTOR CONTACTOR
BR	BLOWER RELAY
CC	COMPRESSOR CONTACTOR
CCH	CRANKCASE HEATER
COMP	COMPRESSOR
CT	CONTROL TRANSFORMER
FT	FREEZE STAT
GL	GROUND LUG
GND	GROUND
HPC	HIGH PRESSURE CONTROL
IBM	INDOOR BLOWER MOTOR
IFC	INTEGRATED FURNACE CONTROL
LAC	LOW AMBIENT CONTROL
LPC	LOW PRESSURE CONTROL
MAS	MIXED AIR SENSOR
OFM	OUTDOOR FAN MOTOR
OPT	OPTIONAL
PCB	PRESSURE CONTROL BOARD
PL	PLUG
RC	RUN CAPACITOR
TB	TERMINAL BLOCK

WIRING INFORMATION

LINE VOLTAGE
- -FACTORY STANDARD ———
- -FACTORY OPTION -·-·-·-·-
- -FIELD INSTALLED ·····

LOW VOLTAGE
- -FACTORY STANDARD ———
- -FACTORY OPTION -·-·-·-·-
- -FIELD INSTALLED ·····

REPLACEMENT WIRE
- -MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105° C MIN.)

WARNING
- -CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C., NATIONAL WIRING REGULATIONS, AND LOCAL CODES AS APPLICABLE.

WIRE COLOR CODE

BK	BLACK	O	ORANGE
BR	BROWN	PR	PURPLE
BL	BLUE	R	RED
G	GREEN	W	WHITE
GY	GRAY	Y	YELLOW

WIRING SCHEMATIC

RLKL-B180/240
208-230V, 3PH, 60HZ. / 460V, 3PH, 60HZ.
575V, 3PH, 60 HZ.
200-220/380-415V 3 PH, 50 HZ.
PACKAGED A/C

DR. BY	APP. BY	DATE	DWG. NO.	REV
MGR		8-16-12	90-42517-53	00