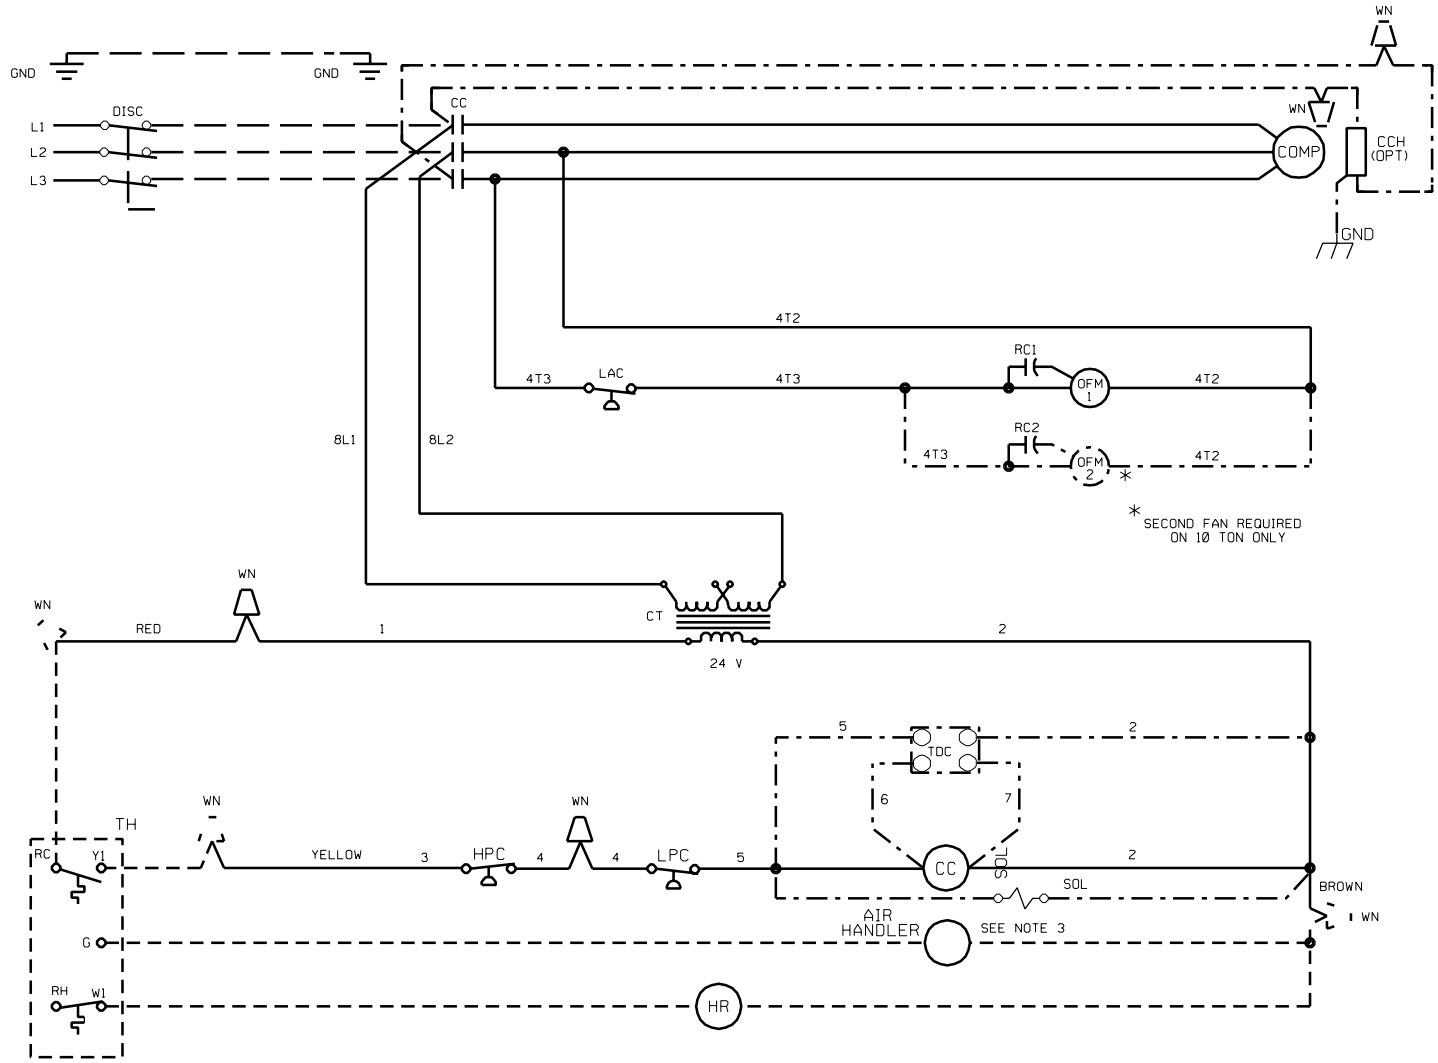


COMPONENT CODE	
CC	COMPRESSOR CONTACTOR
CCH	CRANKCASE HEATER
COMP	COMPRESSOR
CT	CONTROL TRANSFORMER
HPC	HIGH PRESSURE CONTROL
HR	HEATER RELAY
LAC	LOW AMBIENT CONTROL
LPC	LOW PRESSURE CONTROL
OFM	OUTDOOR FAN MOTOR
RC	RUN CAPACITOR
TH	THERMOSTAT (H/C)
TDC	TIME DELAY CONTROL
WN	WIRE NUT

NOTES:

1. REPLACEMENT WIRE & FUSES MUST BE SAME TYPE & SIZE AS ORIGINAL.
2. UNIT MUST BE PERMANENTLY GROUNDED & CONFORM TO N.E.C. & LOCAL CODES.
3. MAXIMUM IN RUSH VA NOT TO EXCEED 92 VA.
4. MINIMUM WIRE SIZE BASED ON 75 DEGREES C INSULATION COPPER WIRE.

WIRING INFORMATION

LINE VOLTAGE
- -FACTORY STANDARD
- -FACTORY OPTION
- -FIELD INSTALLED

LOW VOLTAGE
- -FACTORY STANDARD
- -FACTORY OPTION
- -FIELD INSTALLED

REPLACEMENT WIRE
- -MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105° C MIN.)

WARNING
- -CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C., NATIONAL WIRING REGULATIONS, AND LOCAL CODES AS APPLICABLE.

WIRE COLOR CODE

BK__BLACK	O___ORANGE
BR__BROWN	PR__PURPLE
BL__BLUE	R___RED
G___GREEN	W___WHITE
GY__GRAY	Y___YELLOW

WIRING SCHEMATIC

CONDENSING UNIT

6½, 7½, 10 TON & 12½TON
208/230, 380, 460 3PH 60Hz &
200/220, 380/415 3PH 50Hz &
6½& 7½TON - 575 3PH 60Hz

DR. BY	APP. BY	DATE	DWG. NO.	REV
MCB		8-29-90	90-42456-02	14

DWG. NO. 90-42456-02 REV 14