INSTALLATION INSTRUCTIONS FOR RXGF-CC DOWNFLOW TOP MOUNT EXTERNAL FILTER KIT

⚠ IMPORTANT

TO ENSURE PROPER INSTALLATION AND OPERATION OF THIS PRODUCT, COMPLETELY READ ALL INSTRUCTIONS PRIOR TO ATTEMPTING TO ASSEMBLE, INSTALL, OPERATE, MAINTAIN OR REPAIR THIS PRODUCT. UPON UNPACKING OF FILTER KIT, INSPECT ALL PARTS FOR DAMAGE PRIOR TO INSTALLATION AND START UP.

1. Using the screws provided, assemble the filter frame as shown in Figure 1.

NOTE: The front and rear doors for the casing are shipped to fit furnace cabinets of 24 1/2 ″ width. If installing on a smaller cabinet, the doors must be cut to the proper width. Cut equal amounts from each end of the doors to assure proper alignment. Lines have been etched in the doors for proper cutting sites.


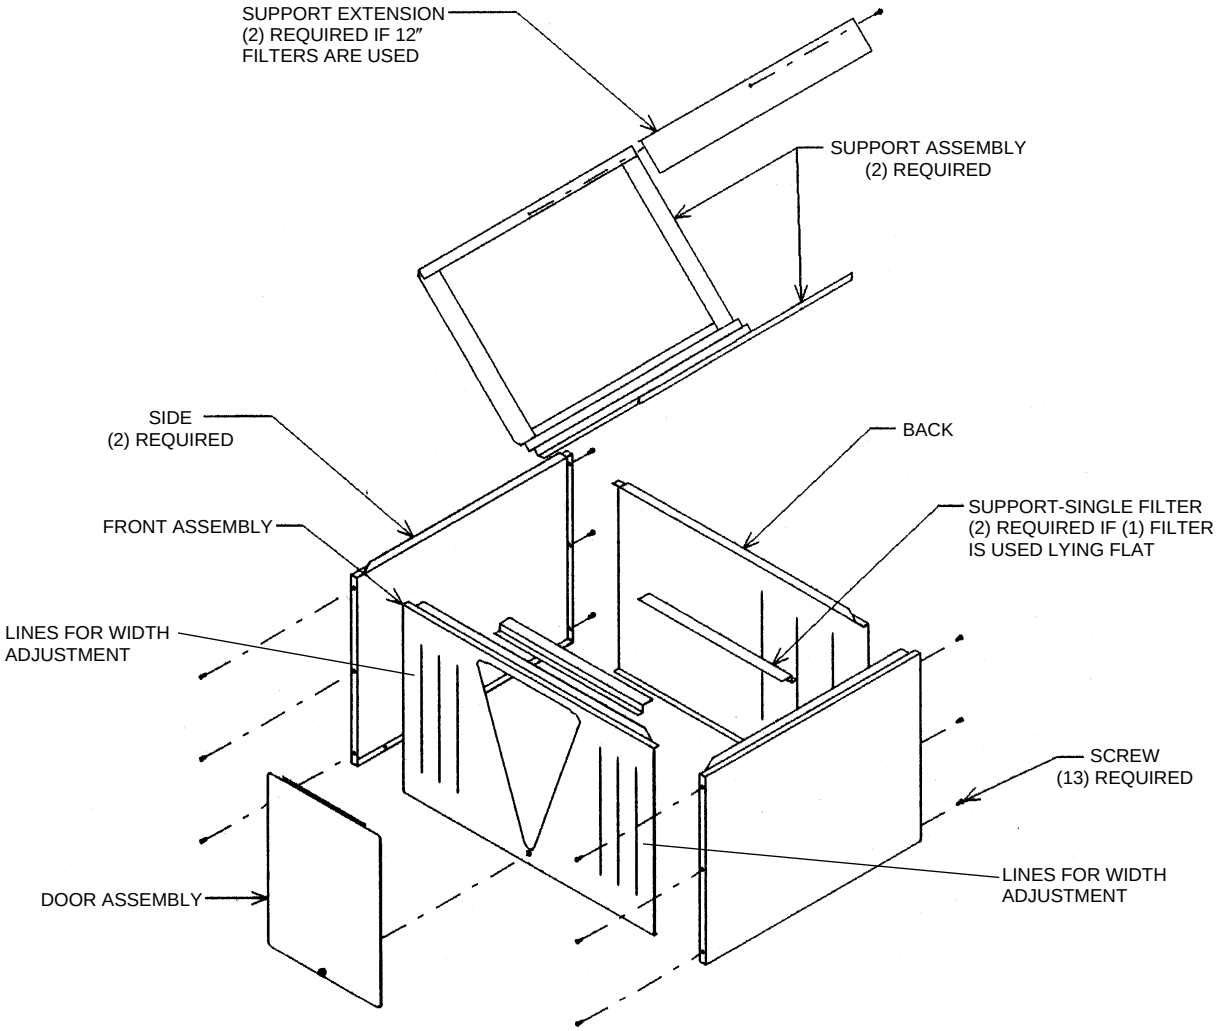


FIGURE 1

2. **FOR MODELS WITH 21″ & 24½″ CABINET:** Install the support assembly shown in Figure 1. **NOTE:** If 12″ filters are used, add the support extension shown in Figure 1.

3. **FOR MODELS WITH 17½″ CABINET:** Install the support brackets at the front and back of the cabinet as shown in Figure 2. These brackets should just sit on the lip of the return air opening and are not attached. **NOTE:** These brackets are not required on 21″ and 24½″ cabinet models.

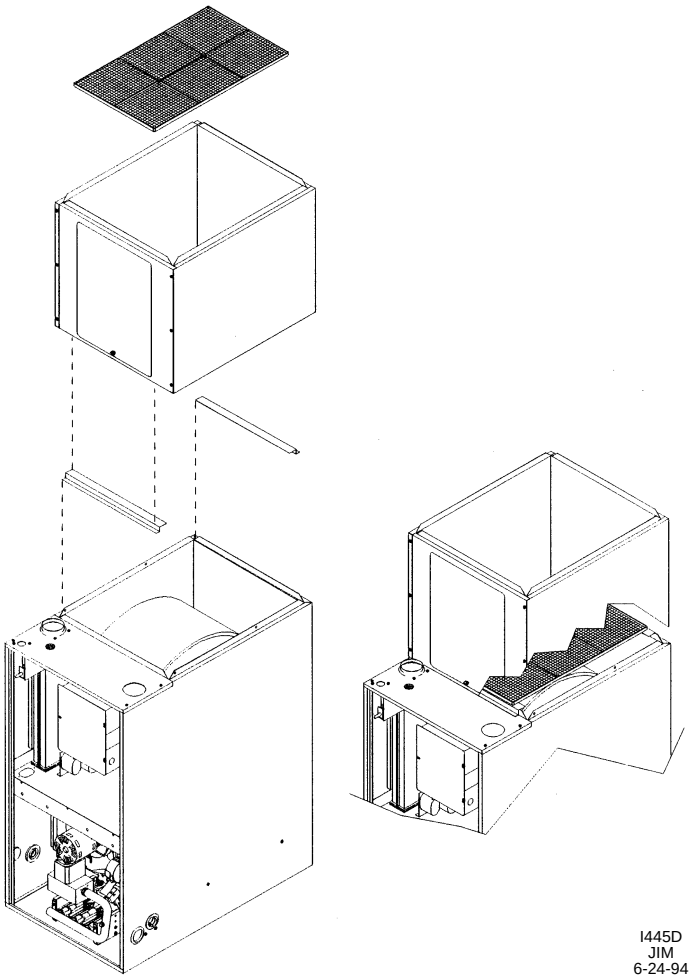


I445D
JIM
6-24-94

FIGURE 2

DOWNFLOW TOP MOUNT W/SINGLE FILTER – RXGF-CC

4. Set the filter casing shown on top of the furnace cabinet. There are four (two on each side) pre-drilled holes on the inside of the filter frame for securing the filter frame to the cabinet. Attach frame with screws provided.

5. Insert filter(s) in place. For 17½″ cabinet models, lay filter in flat as shown in Figure 2. For larger cabinet models, lay filter(s) in support assembly as shown in Figure 3.

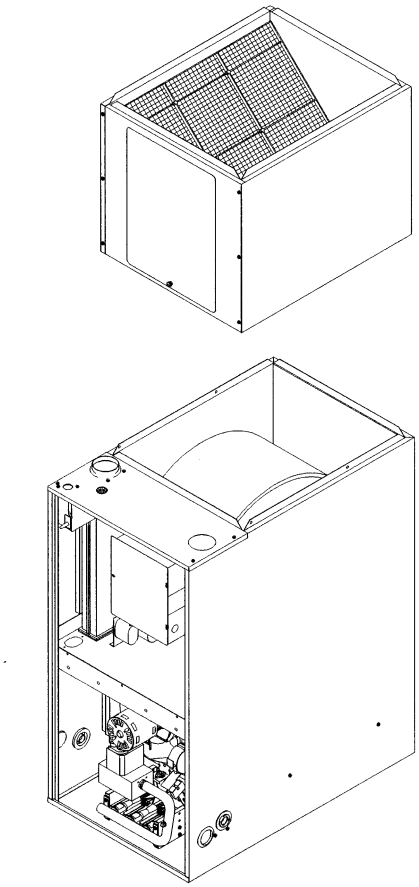

I445C
JIM
6-24-94

FIGURE 3

DOWNFLOW TOP MOUNT – RXGF-CC